


ANEMOSTAT[®]

AIR TERMINAL CONTROLS

Control Package BR - A - 5202

- BYPASS / RELIEF
- ANALOG ELECTRONIC CONTROLS
- AUTOMATIC HTG/CLG CHANGEOVER
- PRESSURE DEPENDENT
- ADJUSTMENTS AT THERMOSTAT

DAMPER ROTATION	
RIGHT HAND CONTROLS	LEFT HAND CONTROLS
CW = OPEN	CW = CLOSE
CCW = CLOSE	CCW = OPEN

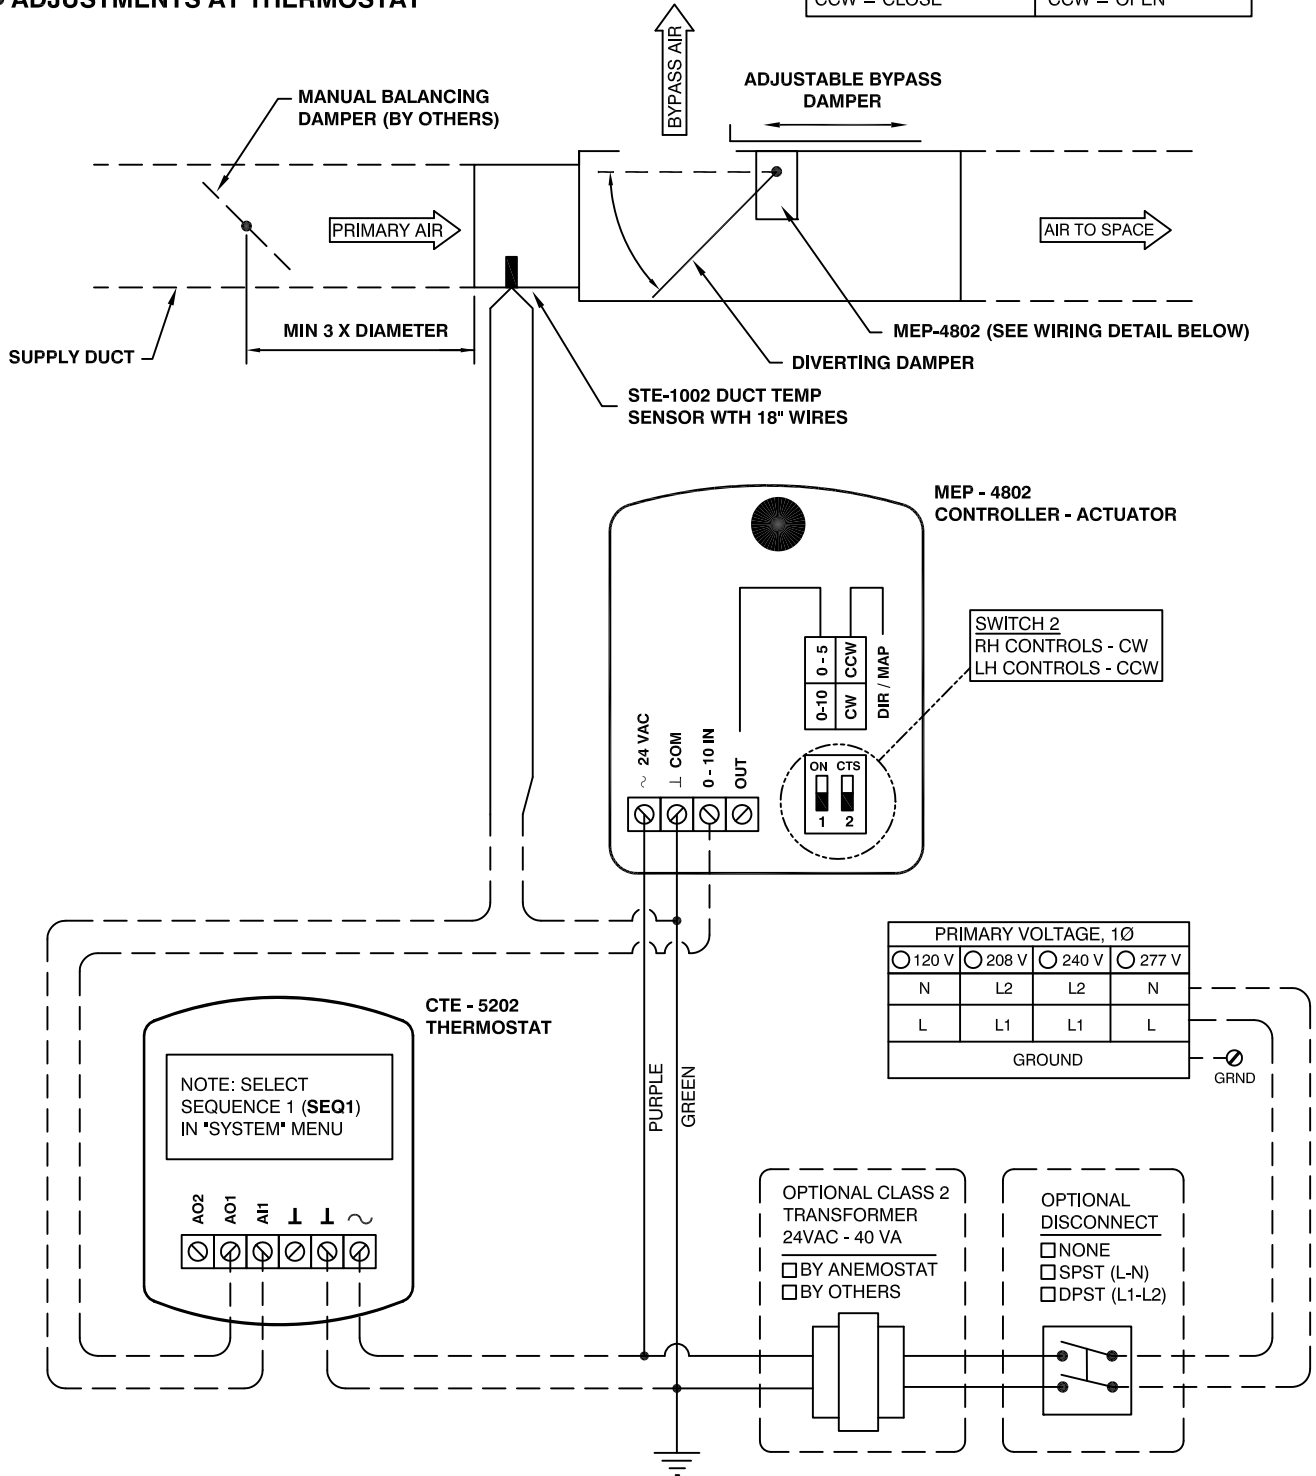

————— FACTORY WIRING
- - - - - FIELD WIRING

REFER TO ANEMOSTAT "CONTROLS MANUAL" (CM-1) FOR ADJUSTMENT & TROUBLESHOOTING PROCEDURES.

JOB NAME:
SUBMITTED BY:
DATE:

DWG #: BR-A-5202.1
REV: B
DATE: 9-27-2017