


ANEMOSTAT[®]

AIR TERMINAL CONTROLS

Control Package BR - A - 5203

- BYPASS / RELIEF
- ANALOG ELECTRONIC CONTROLS
- VAV COOLING
- HOT WATER REHEAT (2-POSITION)
- PRESSURE DEPENDENT
- ADJUSTMENTS AT THERMOSTAT

| DAMPER ROTATION | |
|---------------------|--------------------|
| RIGHT HAND CONTROLS | LEFT HAND CONTROLS |
| CW = OPEN | CW = CLOSE |
| CCW = CLOSE | CCW = OPEN |

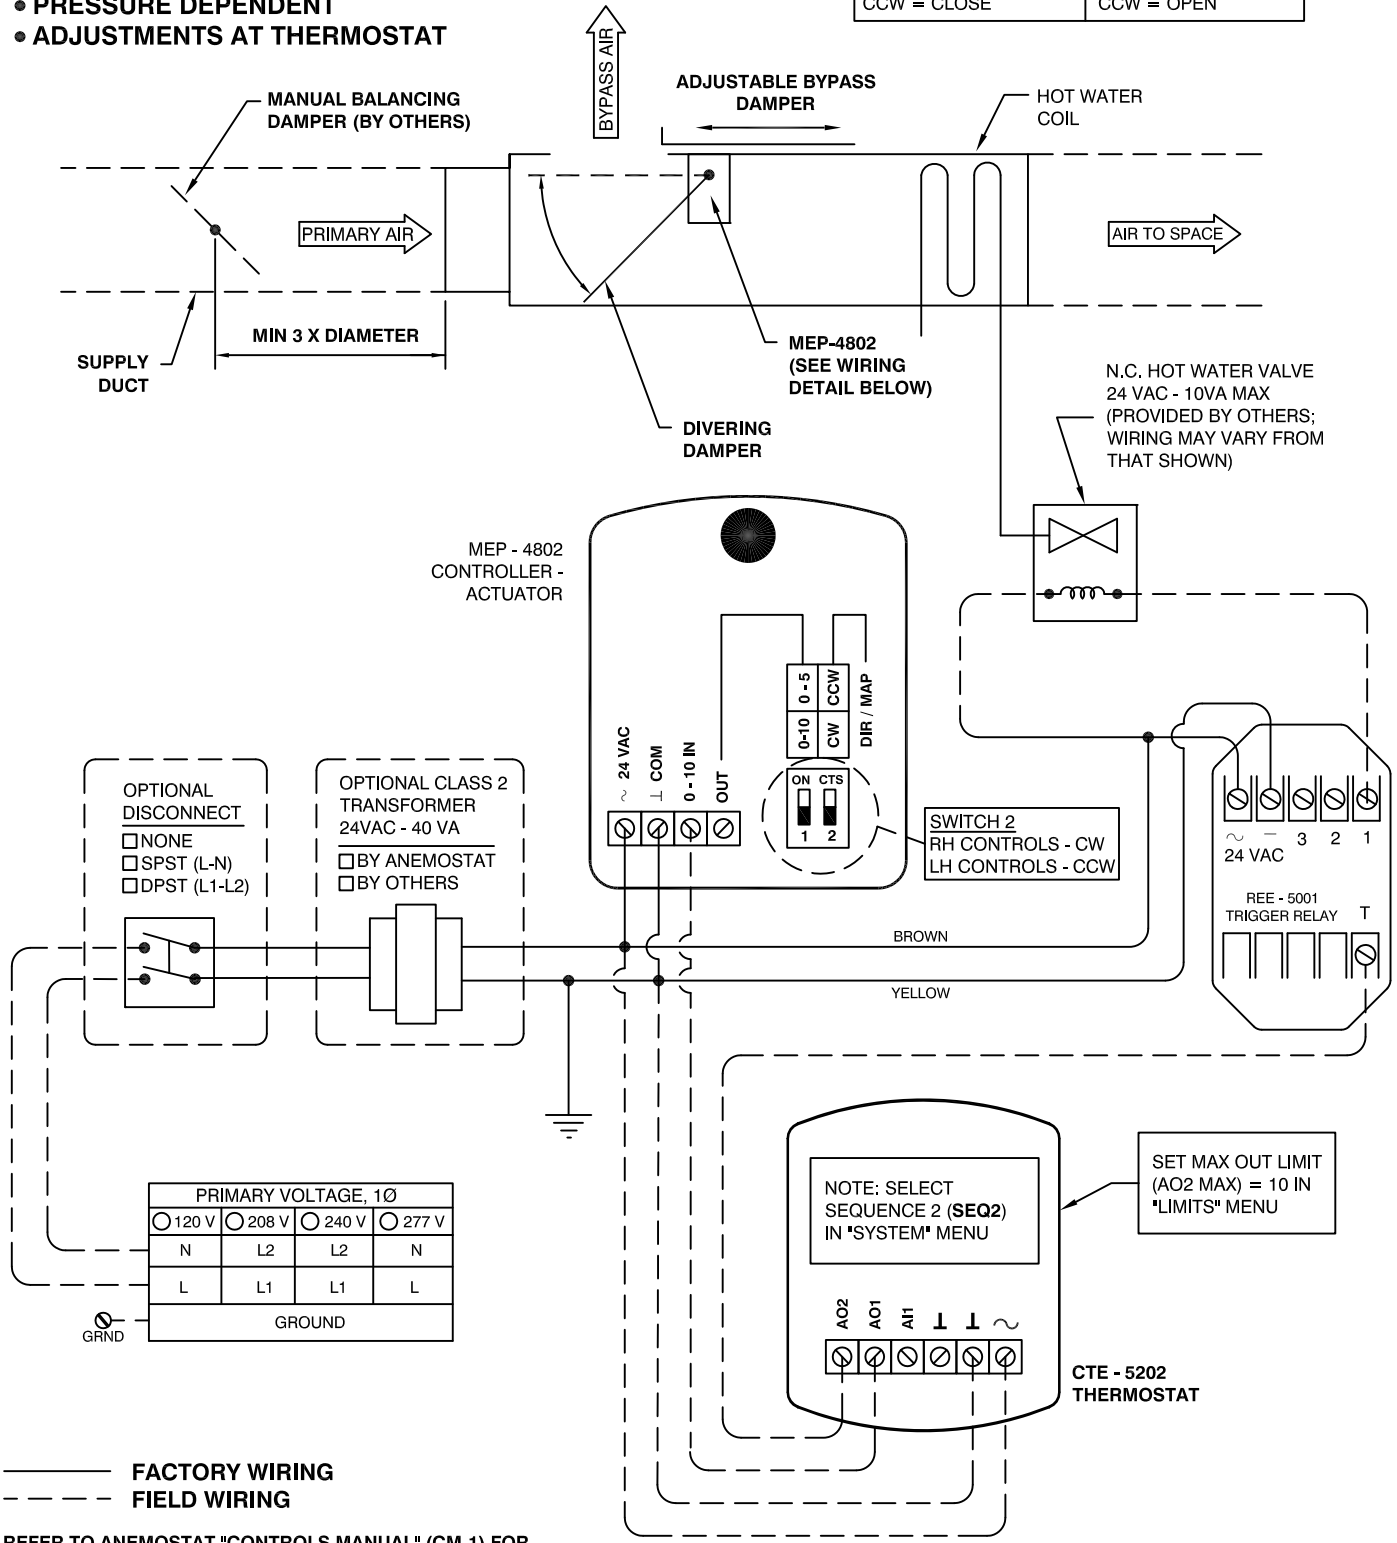

OPTIONAL DISCONNECT

- NONE
- SPST (L-N)
- DPST (L1-L2)

OPTIONAL CLASS 2 TRANSFORMER
24VAC - 40 VA

- BY ANEMOSTAT
- BY OTHERS

| PRIMARY VOLTAGE, 1Ø | | | |
|-----------------------------|-----------------------------|-----------------------------|-----------------------------|
| <input type="radio"/> 120 V | <input type="radio"/> 208 V | <input type="radio"/> 240 V | <input type="radio"/> 277 V |
| N | L2 | L2 | N |
| L | L1 | L1 | L |
| GROUND | | | |

————— FACTORY WIRING
- - - - - FIELD WIRING

REFER TO ANEMOSTAT "CONTROLS MANUAL" (CM-1) FOR ADJUSTMENT & TROUBLESHOOTING PROCEDURES.

JOB NAME:
SUBMITTED BY:
DATE:

DWG #: BR-A-5203
REV: A
DATE: 7-29-14