


# ANEMOSTAT<sup>®</sup>

## AIR TERMINAL CONTROLS

# Control Package

## SD - D - 7002A

- SINGLE DUCT
- BACNET DIGITAL CONTROLS
- VAV COOLING WITH HOT WATER HEAT (2 POSITION)
- PRESSURE INDEPENDENT
- NETSENSOR ABC-1161/1161W

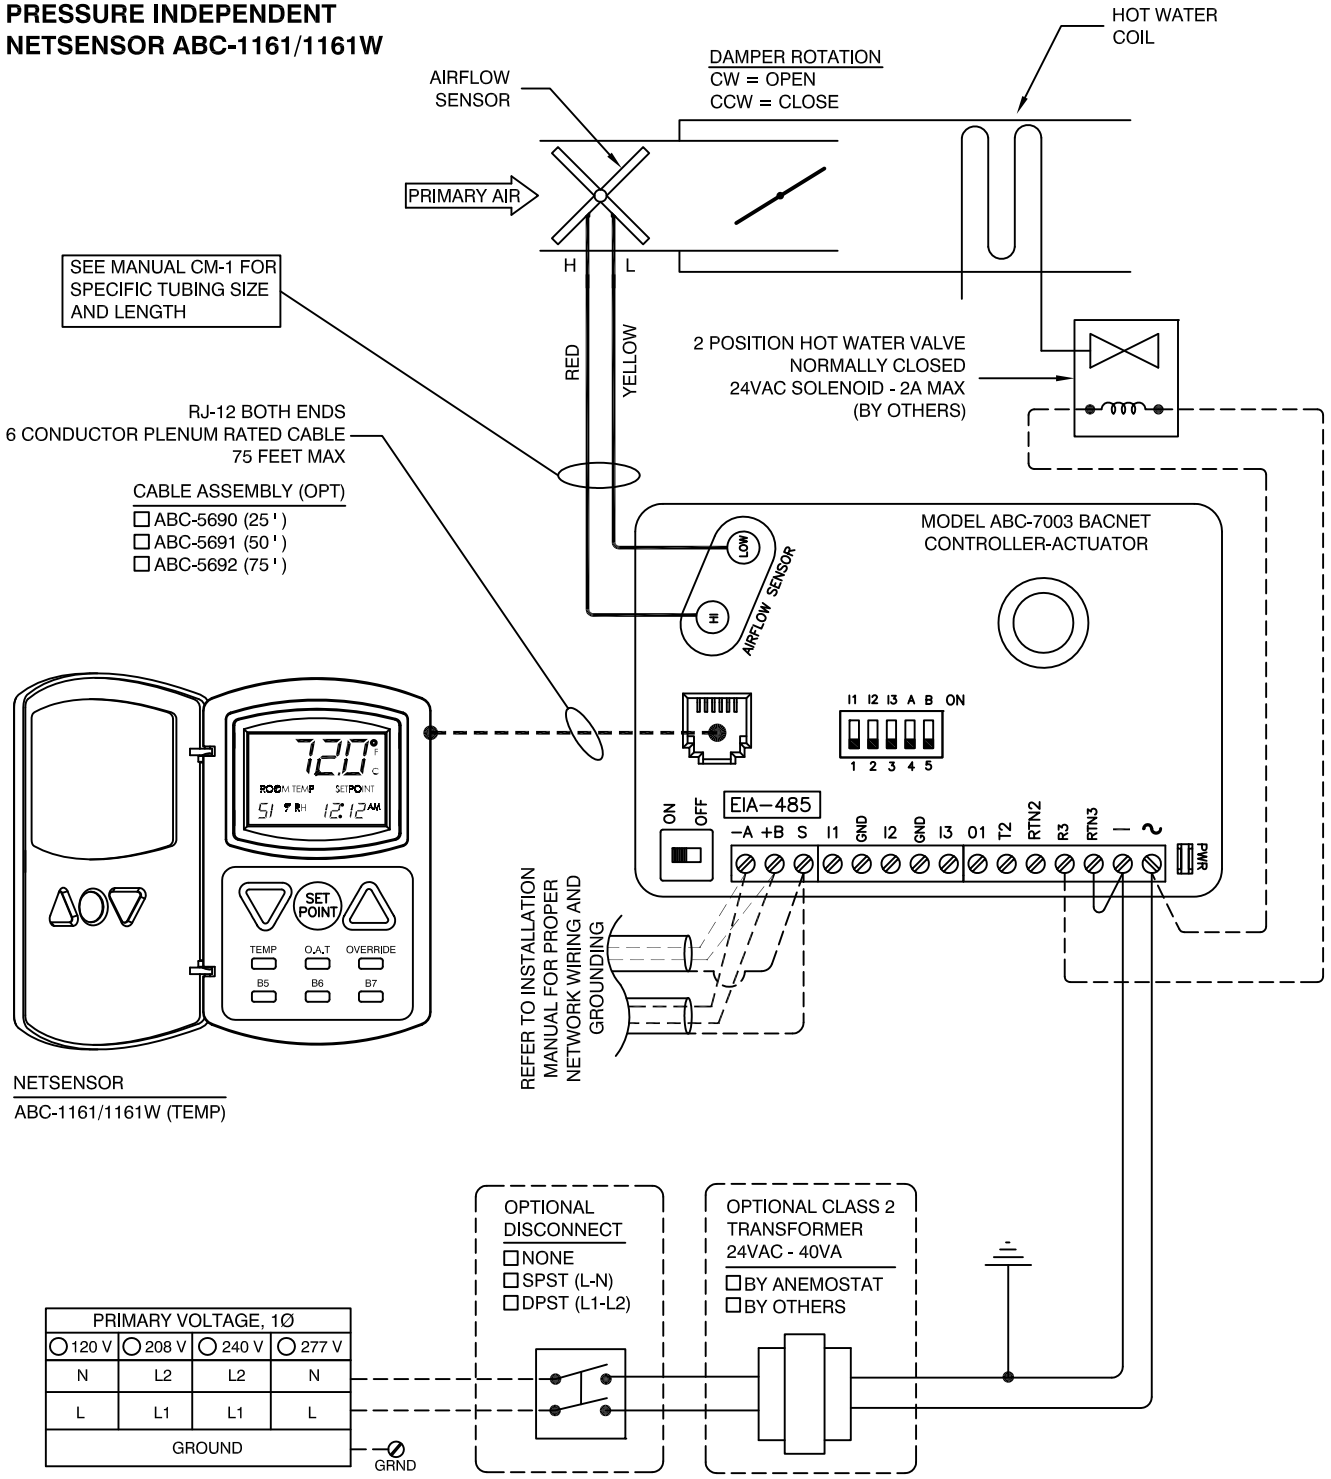

————— FACTORY WIRING  
 - - - - - FIELD WIRING  
 ———— FACTORY PIPING

REFER TO ANEMOSTAT "CONTROLS MANUAL" (CM-1) FOR ADJUSTMENT & TROUBLESHOOTING PROCEDURES.

**JOB NAME:**  
**SUBMITTED BY:**  
**DATE:**

**DWG #:** SD-D-7002A.1  
**REV:** B  
**DATE:** 2-22-13