


ANEMOSTAT[®]

SINGLE DUCT AIR TERMINAL

Control Package
SD - D - 8007D

- BACNET DIGITAL CONTROLS
- VAV HEATING / COOLING CHANGEOVER (AUTO)
- PRESSURE INDEPENDENT
- SENSOR STE-6010W80

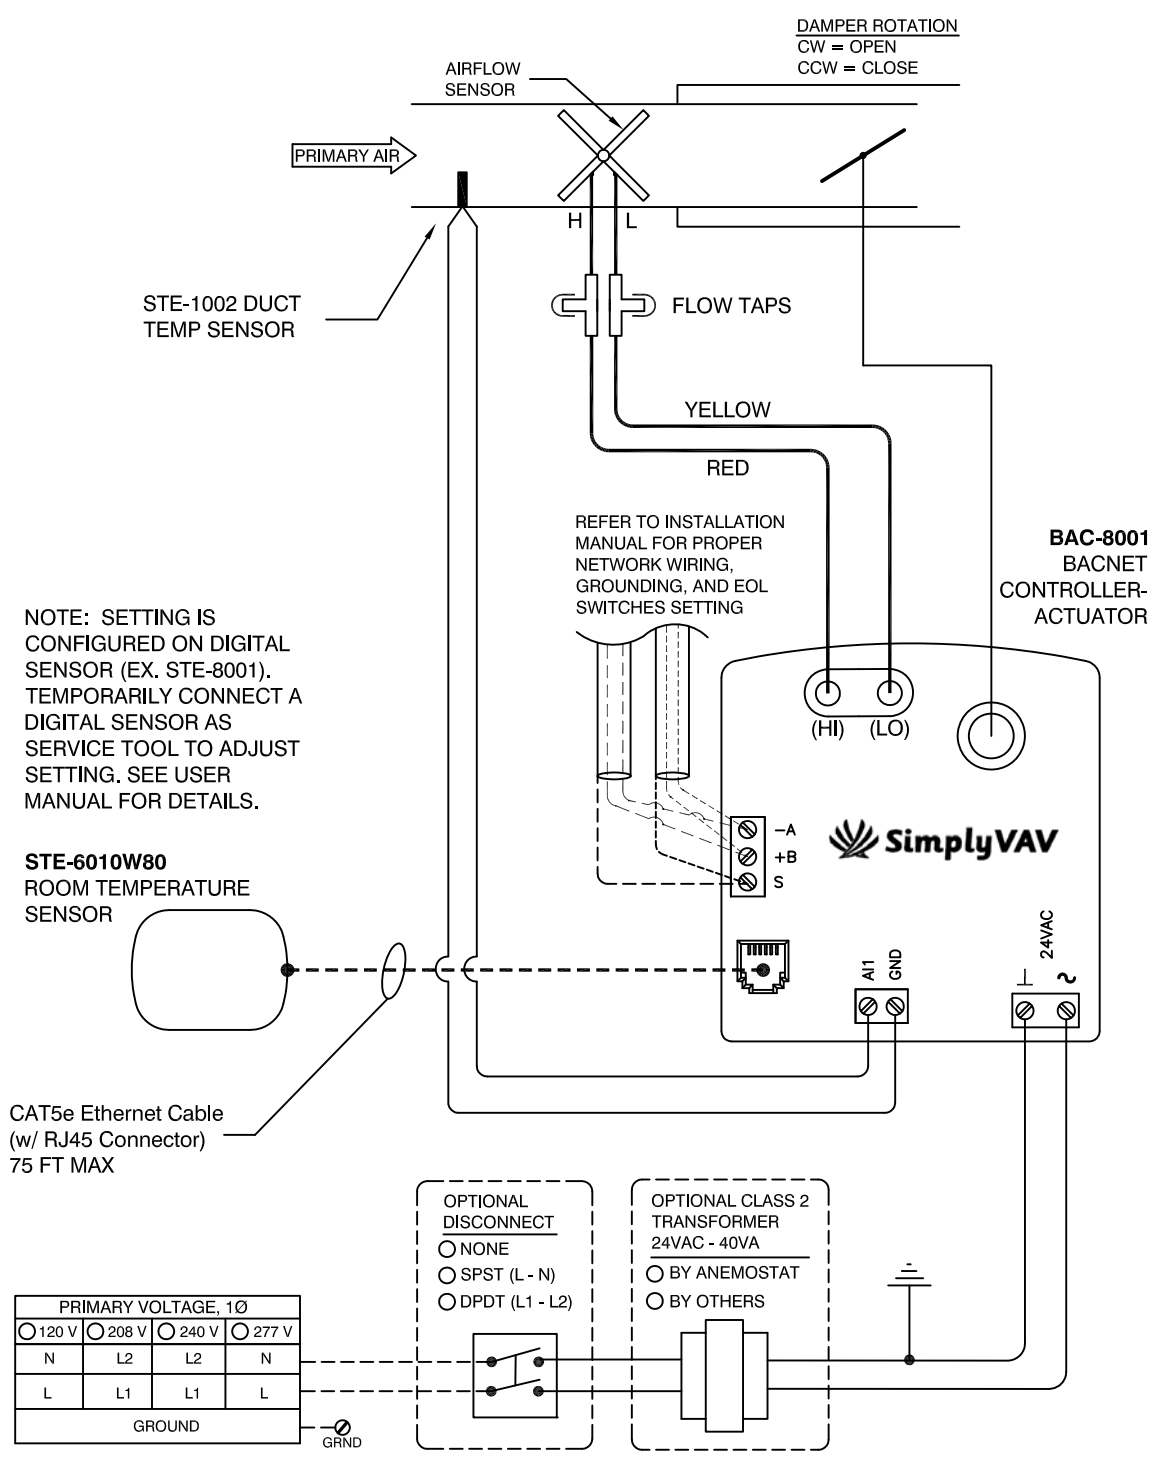

NOTE: SETTING IS CONFIGURED ON DIGITAL SENSOR (EX. STE-8001). TEMPORARILY CONNECT A DIGITAL SENSOR AS SERVICE TOOL TO ADJUST SETTING. SEE USER MANUAL FOR DETAILS.

————— FACTORY WIRING
- - - - - FIELD WIRING
————— FACTORY PIPING

REFER TO ANEMOSTAT "CONTROLS MANUAL" (CM-1) FOR ADJUSTMENT & TROUBLESHOOTING PROCEDURES.

JOB NAME:
SUBMITTED BY:
DATE:

DWG #: SD-D-8007D.1
REV: B
DATE: 03-01-17