


ANEMOSTAT®

SINGLE DUCT AIR TERMINAL


Control Package

SD - D - 8027A

- BACNET DIGITAL CONTROLS
- VAV COOLING / HEATING CHANGEOVER (AUTO)
- HOT WATER REHEAT (PROP 0-10VDC)
- PRESSURE INDEPENDENT
- DIGITAL SENSOR STE-8001W80


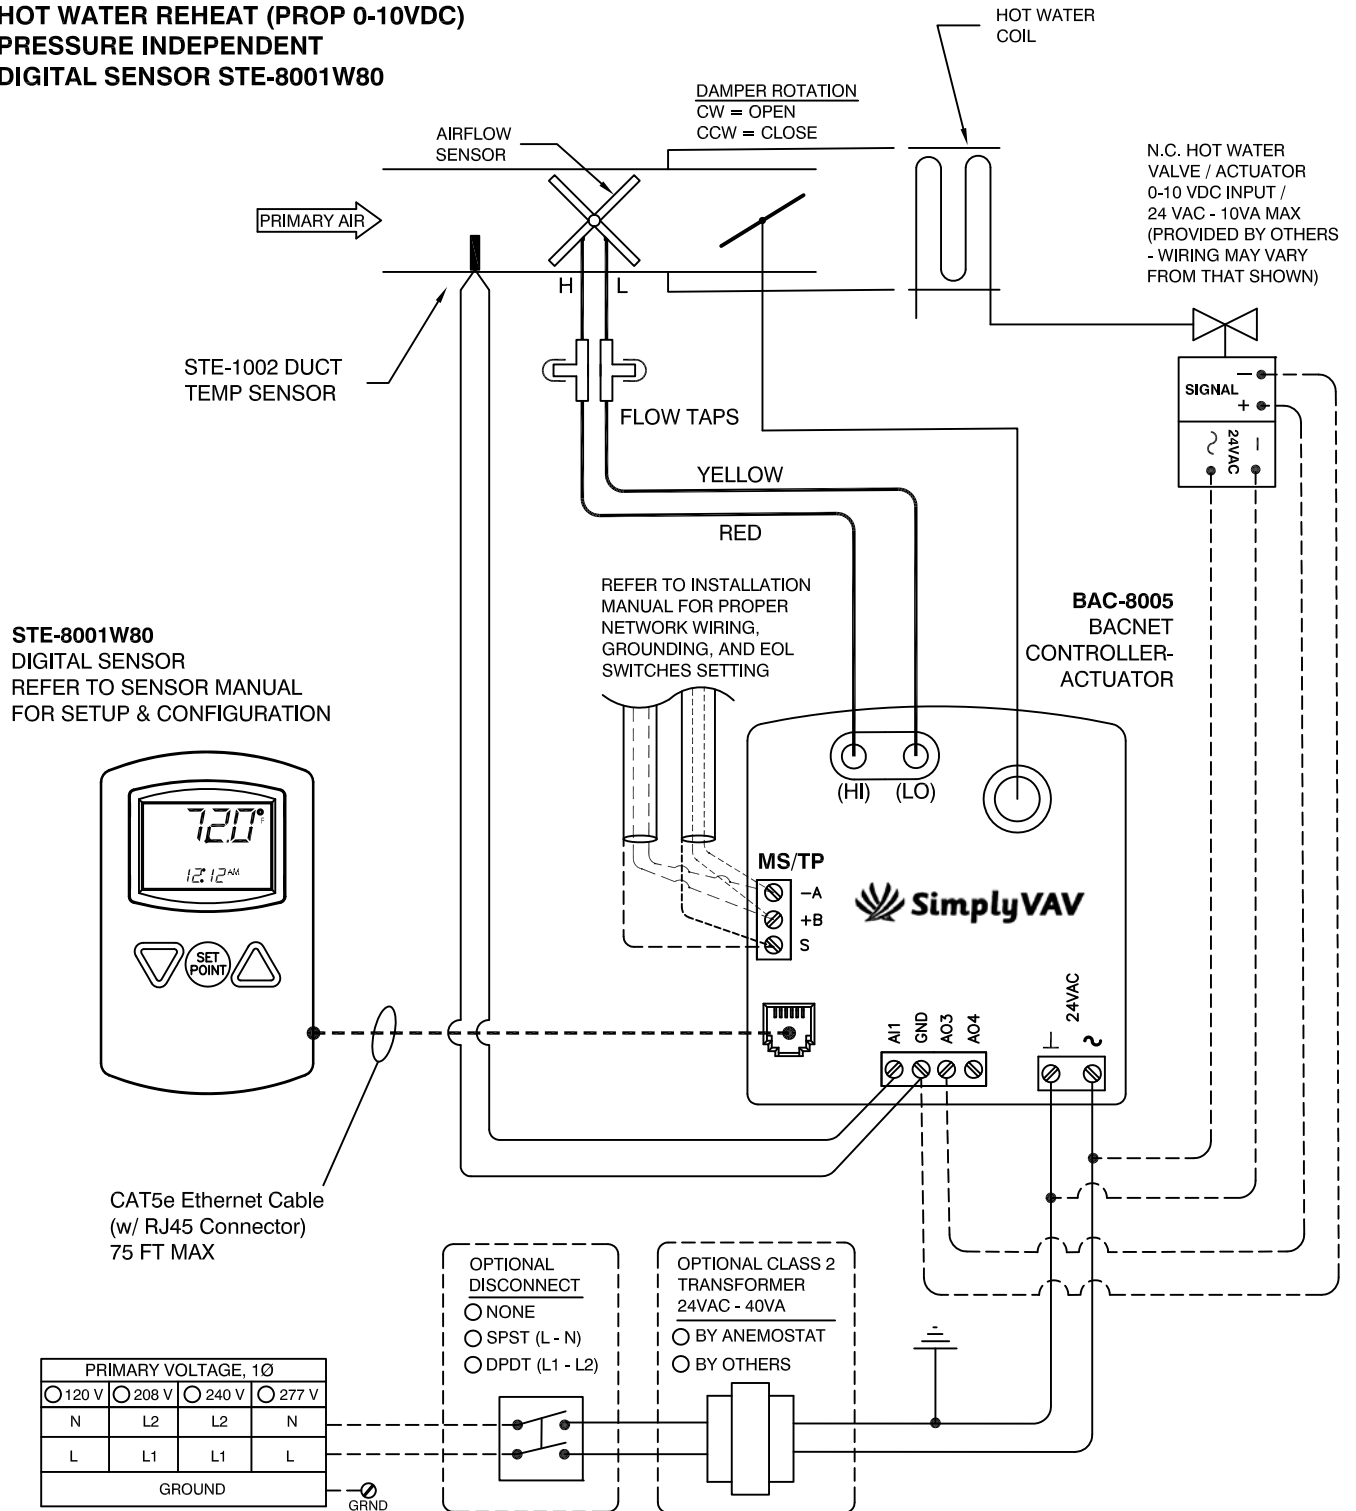


STE-8001W80
DIGITAL SENSOR
REFER TO SENSOR MANUAL
FOR SETUP & CONFIGURATION

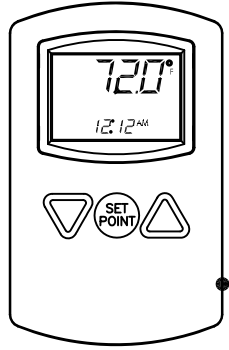

CAT5e Ethernet Cable
(w/ RJ45 Connector)
75 FT MAX

PRIMARY VOLTAGE, 1Ø			
<input type="radio"/> 120 V	<input type="radio"/> 208 V	<input type="radio"/> 240 V	<input type="radio"/> 277 V
N	L2	L2	N
L	L1	L1	L
GROUND			



————— FACTORY WIRING
- - - - - FIELD WIRING
————— FACTORY PIPING

REFER TO ANEMOSTAT "CONTROLS MANUAL" (CM-1) FOR ADJUSTMENT & TROUBLESHOOTING PROCEDURES.

JOB NAME:
SUBMITTED BY:
DATE:

DWG #: SD-D-8027A.1
REV: A
DATE: 03-06-17