


# ANEMOSTAT<sup>®</sup>

AIR TERMINAL CONTROLS

## Control Package SD-D-AA02

- SINGLE DUCT
- ELECTRIC HEAT - SCR CONTROL
- DIRECT DIGITAL CONTROLS BY AMERICAN AUTO-MATRIX
- DDC SUPPLIED TO FACTORY FOR INSTALLATION

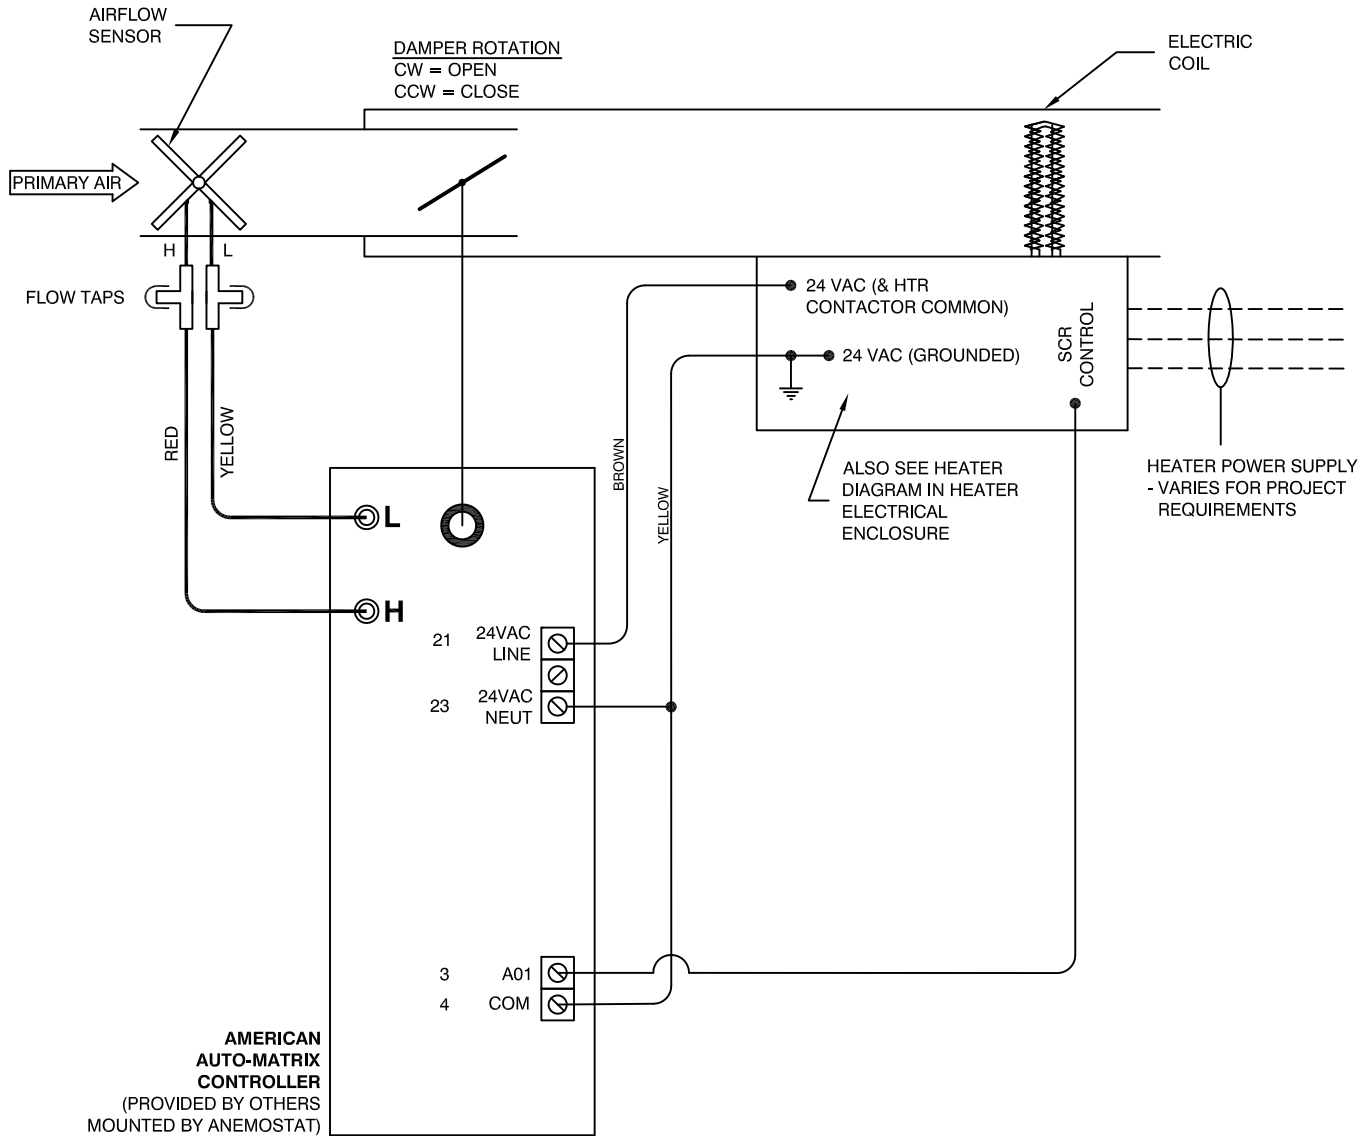

### IMPORTANT!

1. THE 24 VAC SOURCE IS LOCATED IN HEATER ENCLOSURE AND IS SIZED TO HANDLE HEATER CONTACTOR LOAD + 15VA OVERHEAD FOR CONTROLLER AND ACTUATOR.
2. CONSULT CONTROLS DOCUMENTATION FOR DETAILS AS INSTALLED HARDWARE WILL VARY FROM THAT SHOWN.

CONSULT CONTROLS DOCUMENTATION FOR DETAILS AS INSTALLED HARDWARE WILL VARY FROM THAT SHOWN HERE.

**JOB NAME:**  
**SUBMITTED BY:**  
**DATE:**

**DWG #:** SD-D-AA02  
**REV:** -  
**DATE:** 5-17-2017