


# ANEMOSTAT<sup>®</sup>

AIR TERMINAL CONTROLS

## Control Package SD-D-AT02

- SINGLE DUCT
- OPTIONAL HOT WATER HEAT
- DIRECT DIGITAL CONTROLS BY ALERTON
- FACTORY INSTALLED

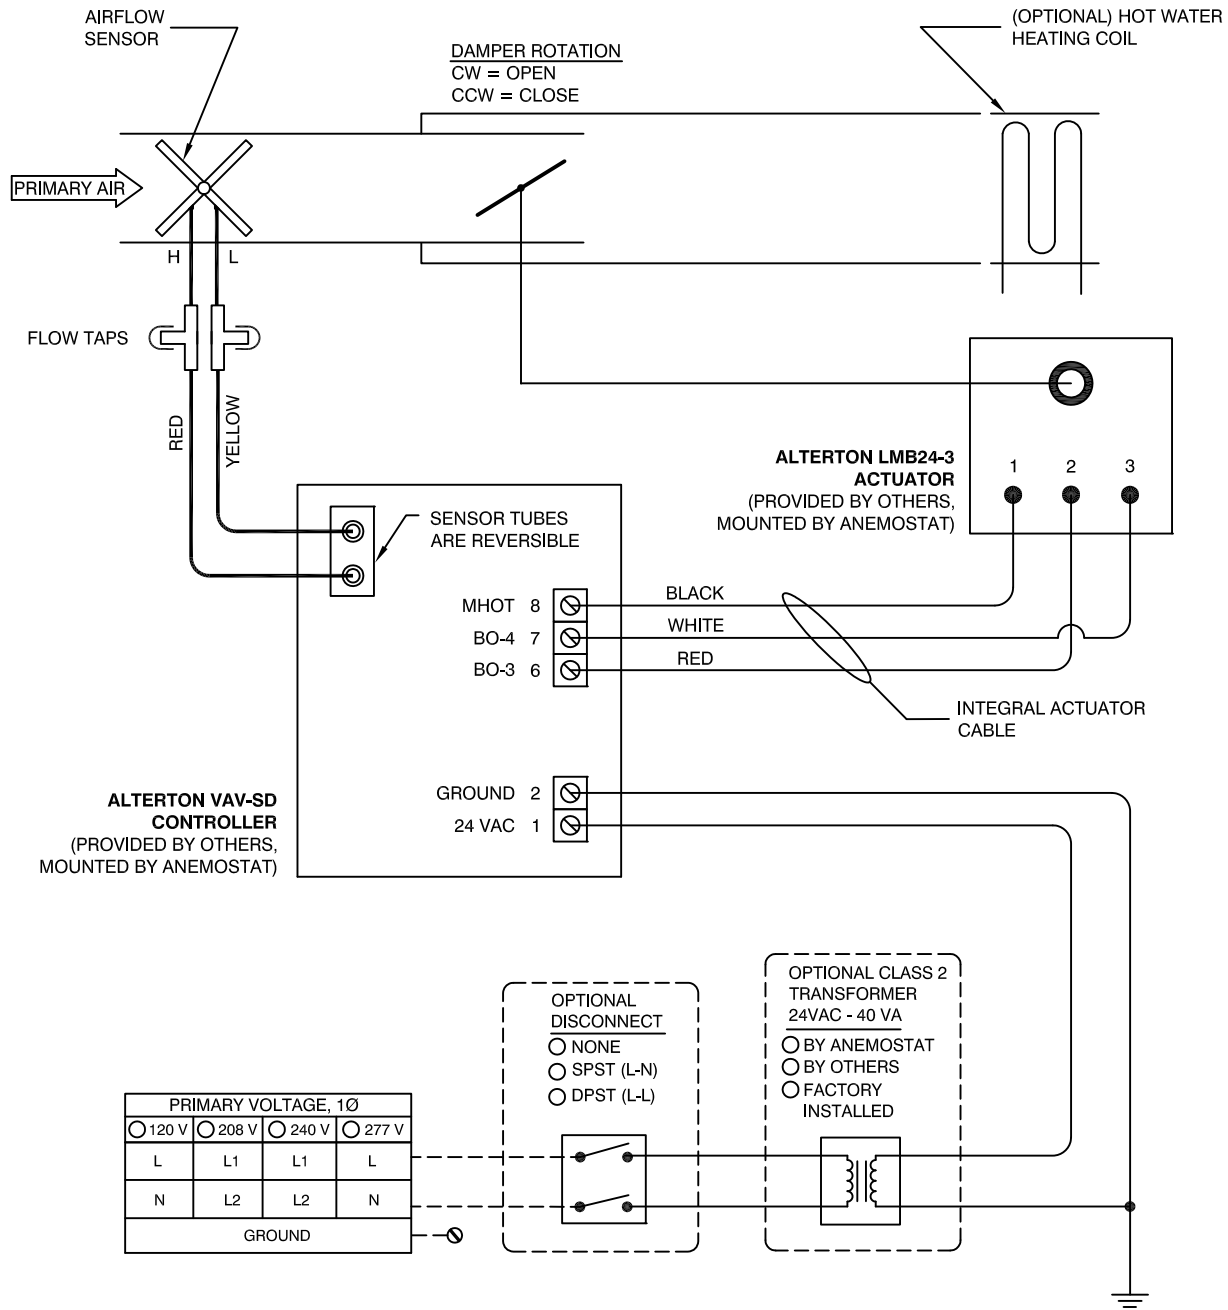

- FACTORY WIRING
- FIELD WIRING
- FACTORY PIPING
- FIELD PIPING

CONSULT CONTROLS DOCUMENTATION FOR DETAILS AS INSTALLED HARDWARE WILL VARY FROM THAT SHOWN HERE.

**JOB NAME:**  
**SUBMITTED BY:**  
**DATE:**

**DWG #:** SD-D-AT02  
**REV:** C  
**DATE:** 2-9-17