


# ANEMOSTAT<sup>®</sup>

## AIR TERMINAL CONTROLS

### Control Package

# SD-D-DC06

- SINGLE DUCT
- OPTIONAL HOT WATER HEAT
- DIRECT DIGITAL CONTROLS PROVIDED BY DISTECH CONTROLS
- FACTORY INSTALLED

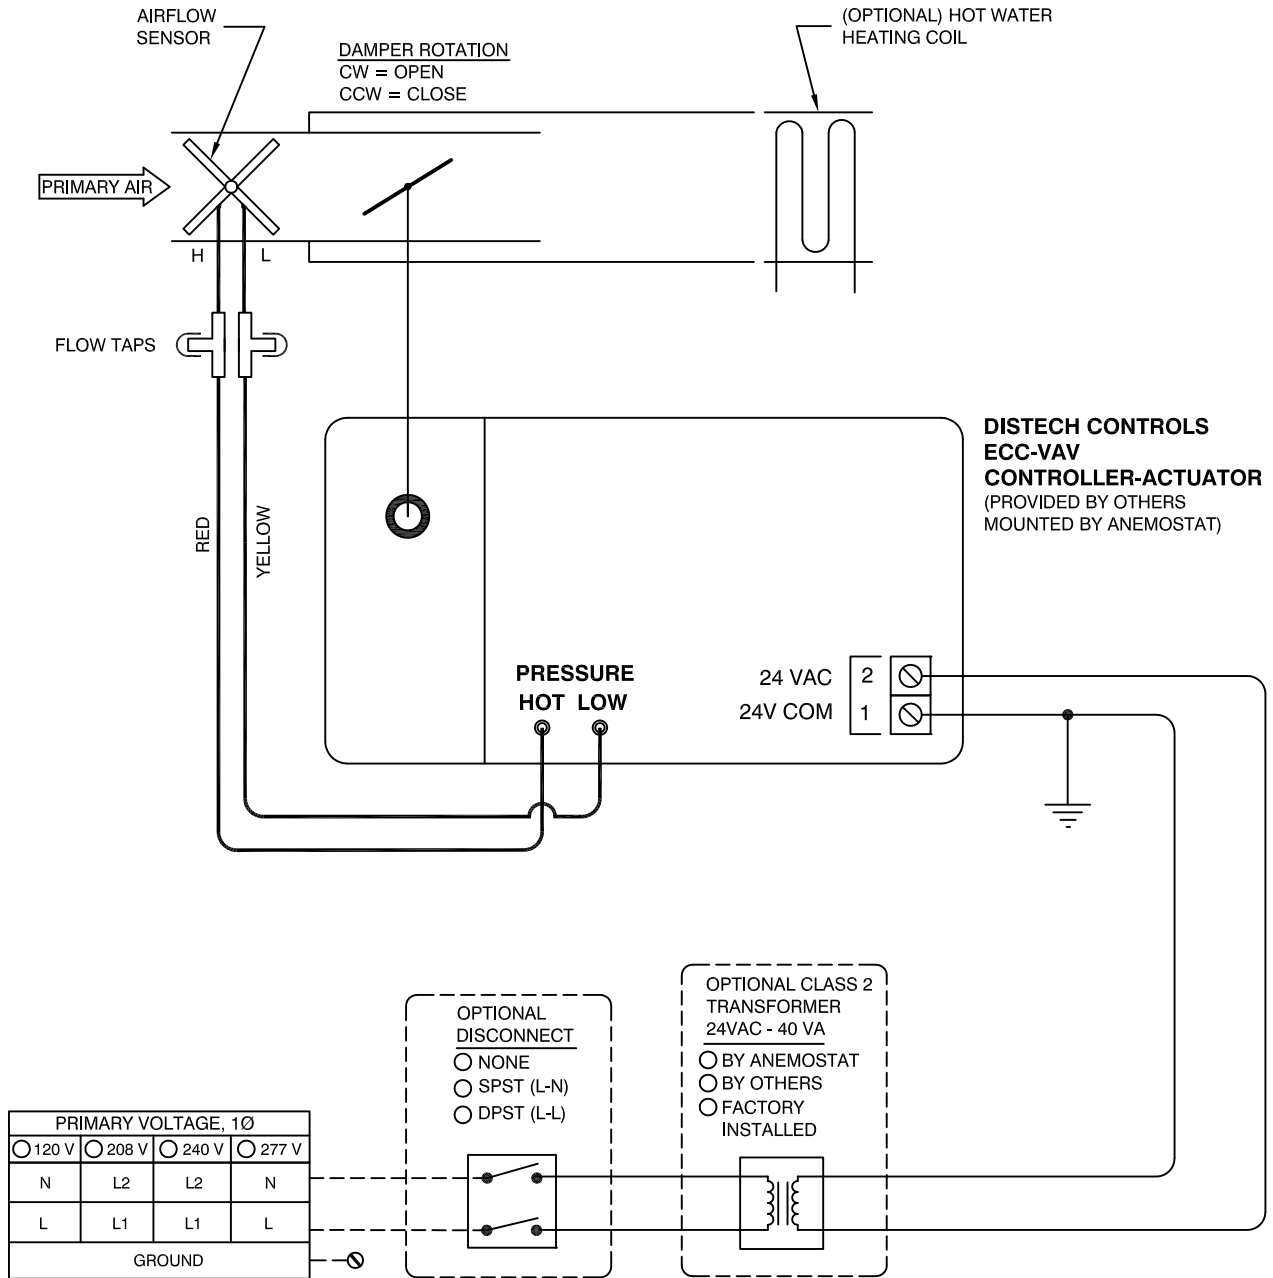

————— **FACTORY WIRING**  
 - - - - - **FIELD WIRING**  
 ———— **FACTORY PIPING**  
 - - - - - **FIELD PIPING**

CONSULT CONTROLS DOCUMENTATION FOR DETAILS AS INSTALLED HARDWARE WILL VARY FROM THAT SHOWN HERE.

**JOB NAME:**  
**SUBMITTED BY:**  
**DATE:**

**DWG #: SD-D-DC06**  
**REV: -**  
**DATE: 8/29/2017**