


# ANEMOSTAT<sup>®</sup>

AIR TERMINAL CONTROLS

## Control Package SD-D-J028

- SINGLE DUCT
- OPTIONAL HOT WATER HEAT
- DIRECT DIGITAL CONTROLS (DDC) BY JOHNSON CONTROLS
- FACTORY INSTALLED DDC

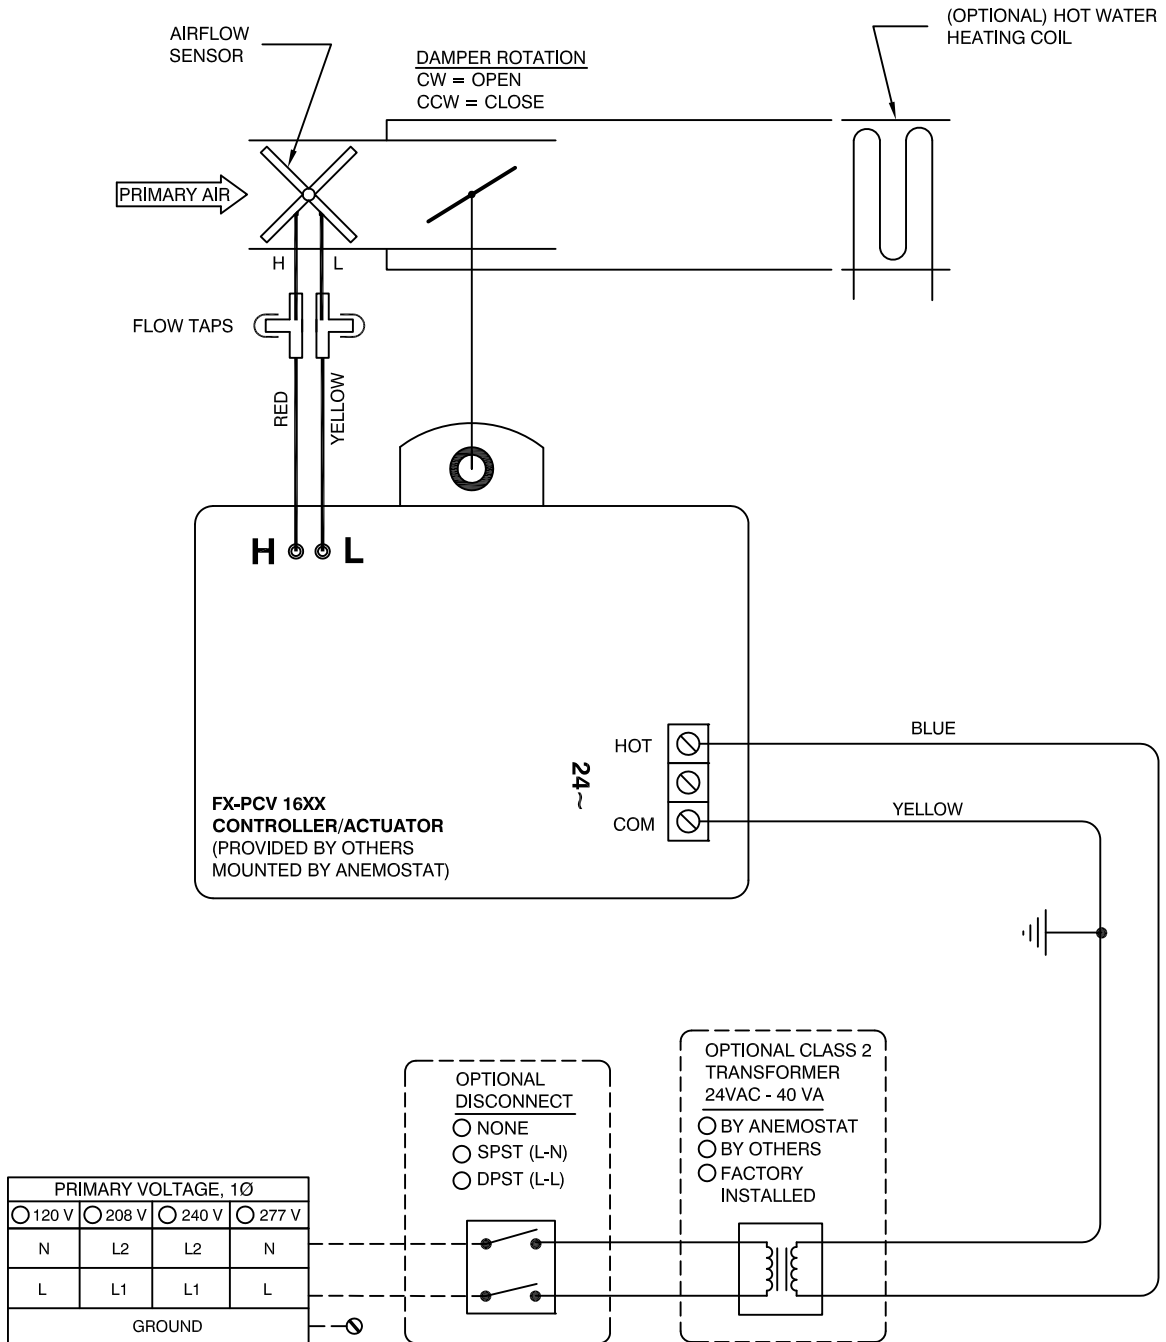

- FACTORY WIRING
- - - - - FIELD WIRING
- FACTORY PIPING
- - - - - FIELD PIPING

CONSULT CONTROLS DOCUMENTATION FOR DETAILS AS INSTALLED HARDWARE WILL VARY FROM THAT SHOWN HERE.

JOB NAME:  
SUBMITTED BY:  
DATE:

DWG #: SD-D-J028  
REV: -  
DATE: 03-22-2017