


ANEMOSTAT[®]

AIR TERMINAL CONTROLS

Control Package SD - D - J034

- SINGLE DUCT
- OPTIONAL HOT WATER HEAT
- DIRECT DIGITAL CONTROLS BY JOHNSON CONTROLS
- FACTORY INSTALLED

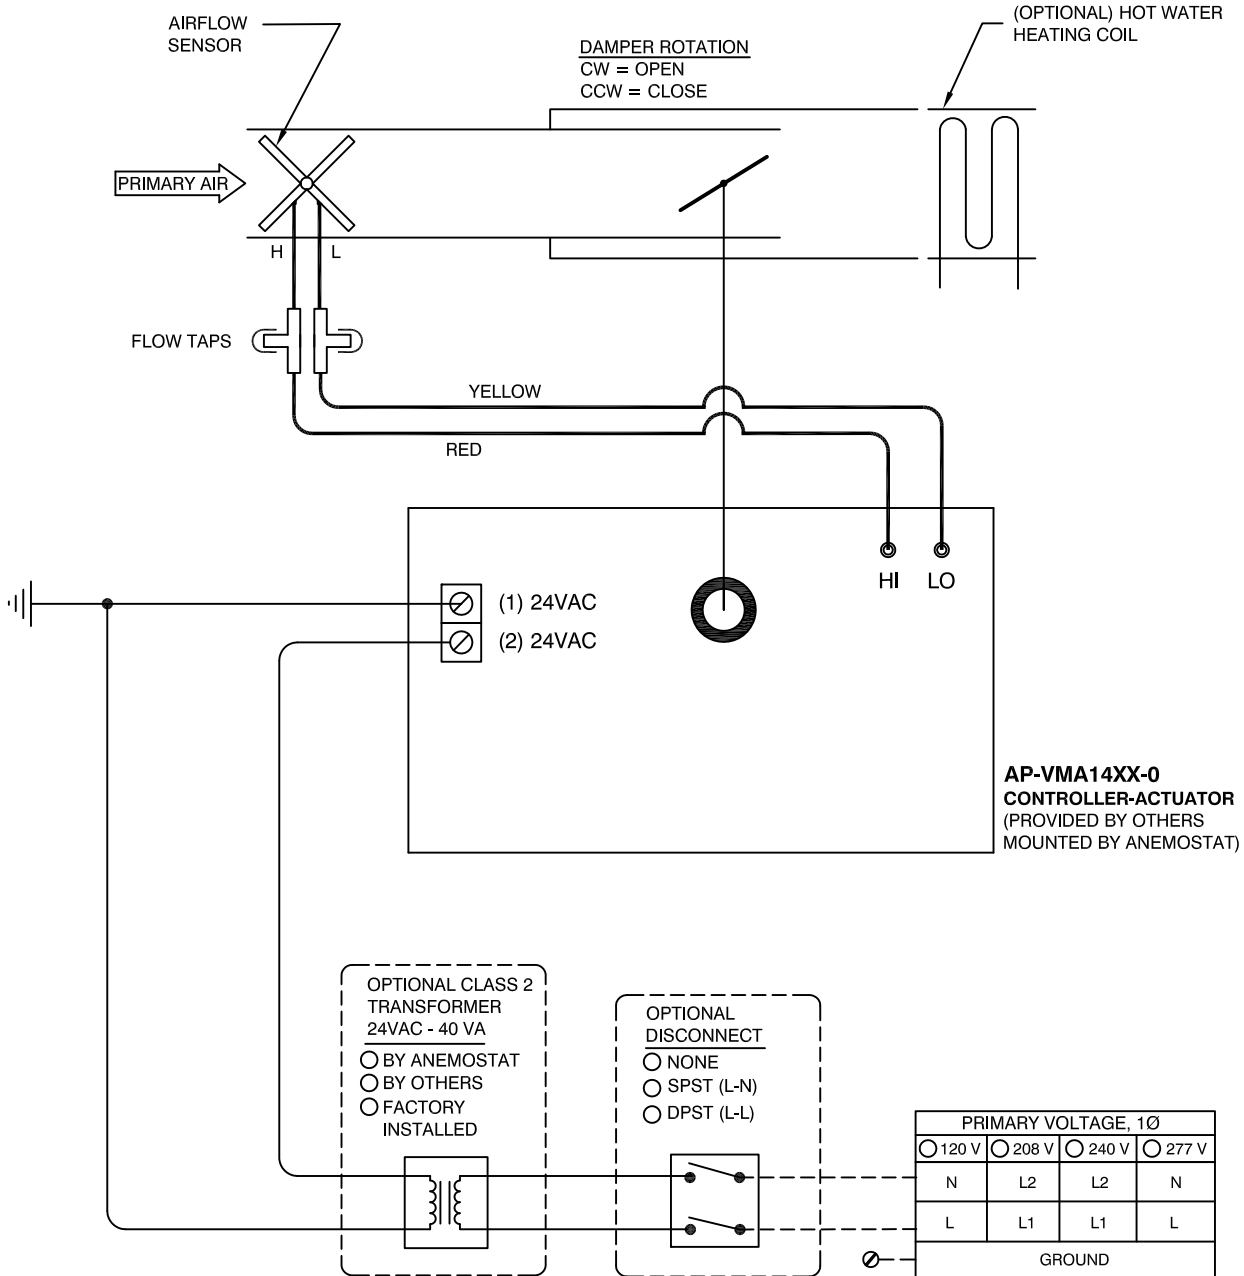

———— FACTORY WIRING
 - - - - - FIELD WIRING
 ———— FACTORY PIPING
 - - - - - FIELD PIPING

CONSULT CONTROLS DOCUMENTATION FOR
 DETAILS AS INSTALLED HARDWARE WILL VARY
 FROM THAT SHOWN HERE.

JOB NAME:
SUBMITTED BY:
DATE:

DWG #: SD-D-J034
REV: -
DATE: 3-24-2017