


ANEMOSTAT[®]


AIR TERMINAL CONTROLS

Control Package
SD-D-J045

- SINGLE DUCT
- OPTIONAL HOT WATER HEAT
- DIRECT DIGITAL CONTROLS (DDC) BY JOHNSON CONTROLS
- FACTORY INSTALLED DDC

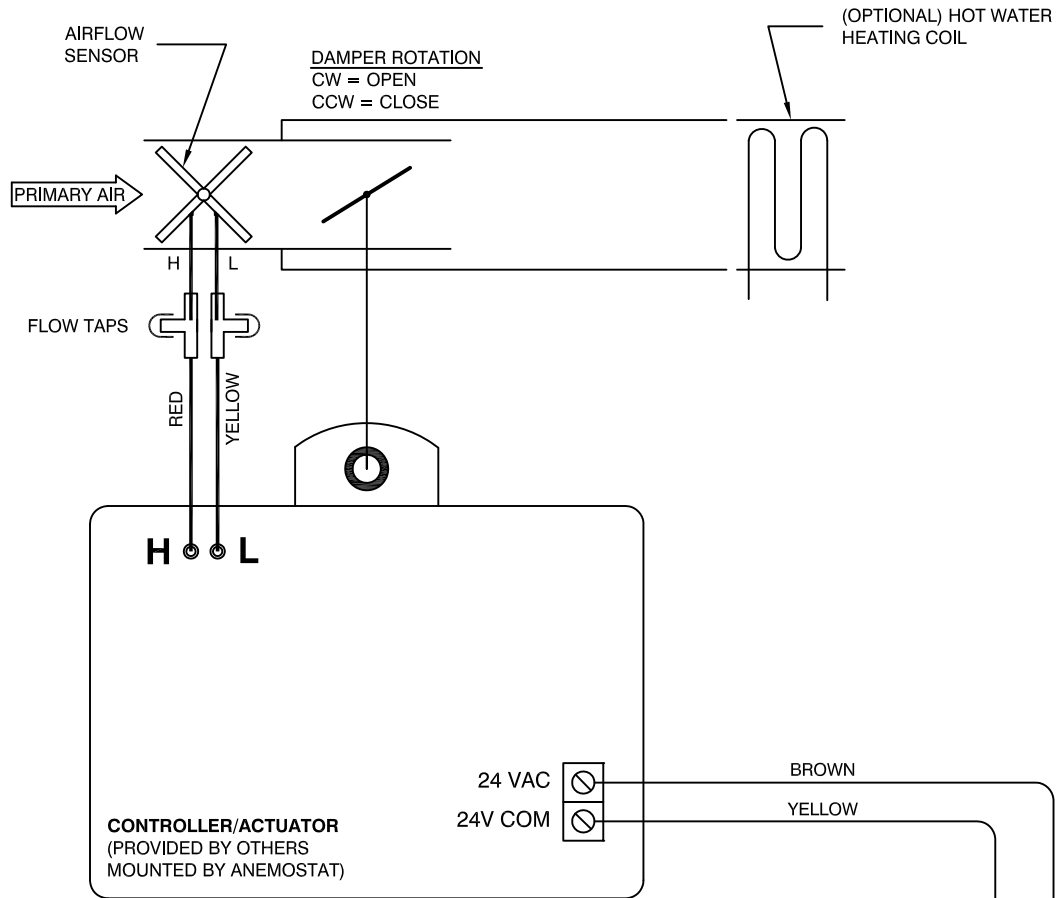

NOTE:
"24 VAC POWER COMING FROM POWER PANELS LOCATED IN ELECT ROOM."
-per controls contractor wiring diagram

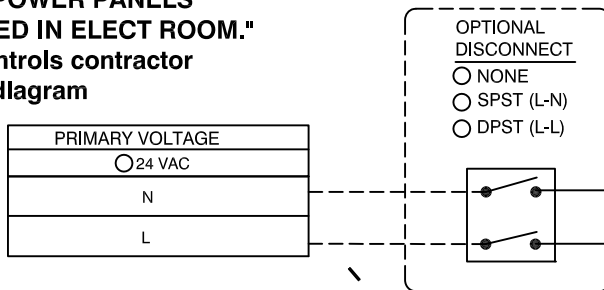

———— FACTORY WIRING
- - - - - FIELD WIRING
———— FACTORY PIPING
- - - - - FIELD PIPING

CONSULT CONTROLS DOCUMENTATION FOR DETAILS AS INSTALLED HARDWARE WILL VARY FROM THAT SHOWN HERE.

JOB NAME:
SUBMITTED BY:
DATE:

DWG #: SD-D-J045
REV: -
DATE: 5-2-2017