

### CONTENTS

- Introduction ..... 1
- Set Drive Hub (45/60°) Rotation Limit..... 1
- Mount Controller..... 2
- Connect Sensors and Equipment ..... 3
- Connect (Optional) Pressure Sensor..... 4
- Connect (Opt.) Ethernet Network ..... 4
- Connect (Optional) MS/TP Network..... 5
- Connect Power ..... 5
- Power and Communication Status..... 5
- MS/TP Network Isolation Bulbs ..... 6
- Watch Dog Jumper ..... 7
- Configure/Program the Controller ..... 7
- Sample (BAC-9001) Wiring ..... 8
- Input/Output Objects/Connections ..... 9
- Replacement Parts ..... 10
- Important Notices ..... 10

### INTRODUCTION


Complete the following steps to install a KMC Conquest™ BAC-9000 Series VAV Controller-Actuator. For controller specifications, see the [data sheet](#) at [kmcontrols.com](http://kmcontrols.com). For additional information, see the [KMC Conquest Controller Application Guide](#).

### SET DRIVE HUB (45/60°) ROTATION LIMIT

**NOTE:** Complete the steps in this section **if** the VAV damper rotation limit is either **60 or 45** degrees.

**NOTE:** If the VAV damper rotates **90** degrees, skip this section and go to [Mount Controller on page 2](#) instead.

1. Push and hold the **gear release** **1** and rotate the **drive hub** and **V-clamp** **2** to the left.

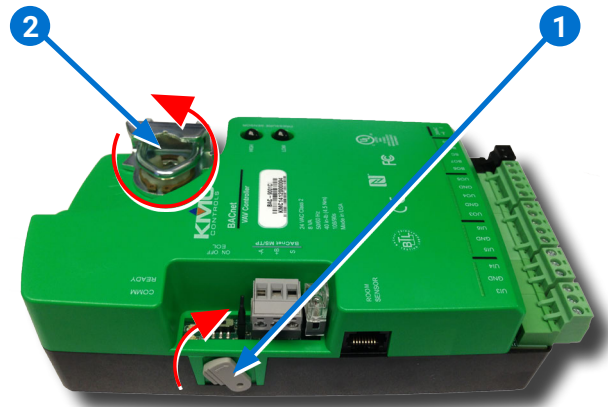

**NOTE:** The **V-clamp nuts** **3** should be on top.



2. Turn the controller over.
3. Remove the **stop screw** **4** from the storage location and clean any debris from the threads.



4. Insert the stop screw into the **60** **5** or **45** **6** stop hole position.



5. Tighten the screw until the screw head touches the plastic in the bottom of the recess.


**NOTE:** Overtightening the screw can cause compression in the case which may interfere with the controller operation.

## MOUNT CONTROLLER

**NOTE:** Install the controller in a metal enclosure for RF shielding and physical protection.

**NOTE:** The controller can be installed on a 3/8–5/8 inch (9.5–16 mm) round or 3/8–7/16 inch (9.5–11 mm) square damper shaft with a minimum length of 2 inches (51 mm).


1. Manually rotate the **damper shaft** 7 on the VAV box to fully open the damper.

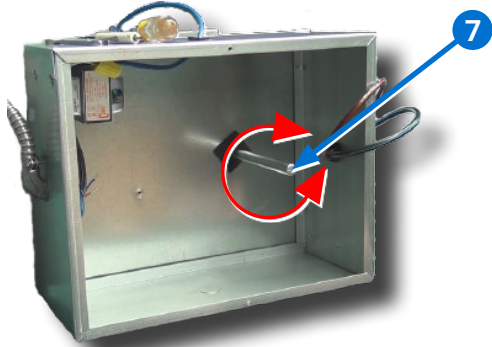

**NOTE:** The drive hub and V-clamp will be rotated in the same direction in Step 8.

2. Push and hold the **gear disengagement lever** 8 on the side of the controller.
3. Rotate the **drive hub and V-clamp** 9 in the same direction that opened the damper.


**NOTE:** Continue to rotate the drive hub and V-clamp until they reach a stop.

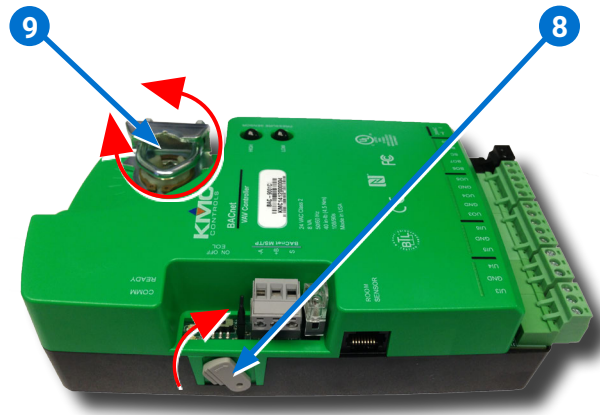


4. Position the controller over the **damper shaft** 10 so that the color-coded **terminal blocks** are easy to access for wiring.

**NOTE:** The black terminals are for power. The green terminals are for inputs and outputs. The gray terminals (if present) are for MS/TP communication.

5. Finger-tighten the **V-clamp nuts** 11 to position the damper shaft in the drive hub.

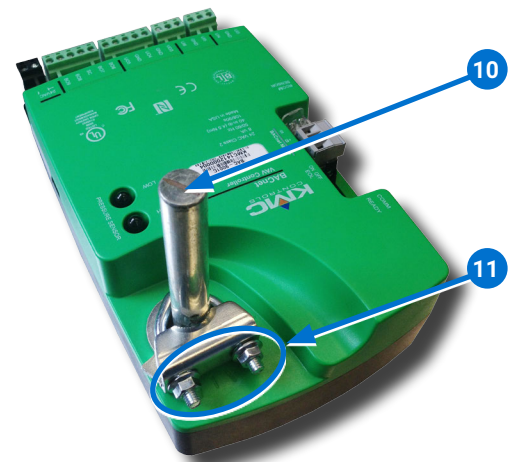

6. Center the **mounting bushing** 12 in the **mounting tab** 13.

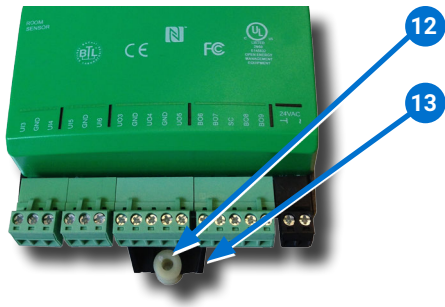

- Attach the controller to the VAV box with a **#8 sheet metal screw** through the **mounting bushing 12**.
- Evenly tighten the **V-clamp nuts 11** on the drive hub to 30–35 in-lb.

## CONNECT SENSORS AND EQUIPMENT

**NOTE:** For more information, see [Sample \(BAC-9001\) Wiring on page 8](#), [Input/Output Objects/Connections on page 9](#), and the YouTube video [KMC Conquest Wiring: BAC-9000 Series Unitary Controllers](#).

**NOTE:** A digital **STE-9000 Series NetSensor** can be used for configuring the controller (see [Configure/Program the Controller on page 7](#)). After the controller has been configured, an **STE-6010**, **STE-6014**, or **STE-6017** analog sensor can be connected to the controller in place of the NetSensor. See the relevant installation guide for additional details.


- Plug an **Ethernet patch cable 14** connected to an STE-9xxx or STE-6010/6014/6017 sensor into the controller's (**yellow 22**) **ROOM SENSOR 15** port.



**NOTE:** The Ethernet patch cable should be a maximum of 150 feet (45 meters).

### ⚠ CAUTION

**On Conquest "E" models, do NOT plug a cable meant for Ethernet communications into the Room Sensor port! The Room Sensor port powers a NetSensor, and the supplied voltage may damage an Ethernet switch or router.**

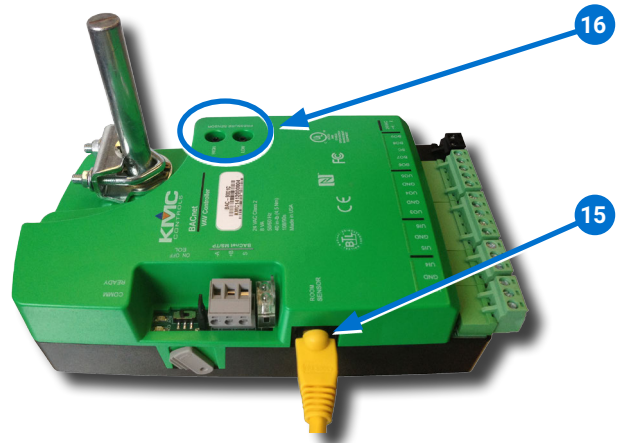

**NOTE:** Auxiliary VAV equipment such as fans, heaters, reheat valves, and discharge air temperature sensors can be connected to the controller.

- Connect auxiliary VAV equipment to the input and output **green terminal blocks 17**.

### ⚠ CAUTION


**Do NOT connect 24 VAC to the analog outputs (U03–U05 and GNDs)!**

**NOTE:** Use 24 VAC (only) with triac outputs (B06–B09 with SC).

**NOTE:** Wire sizes 12–24 AWG can be clamped in each terminal.

**NOTE:** No more than two (16 AWG) wires can be joined at a common point.



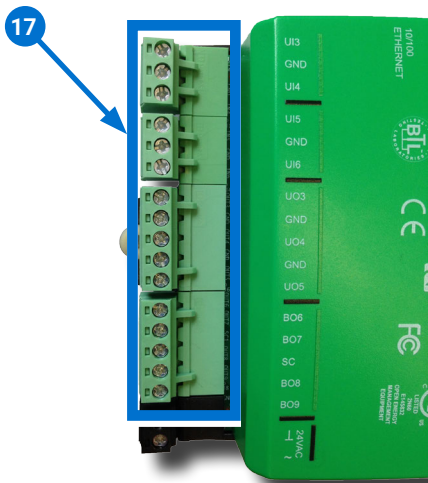


### CONNECT (OPTIONAL) PRESSURE SENSOR

**NOTE:** Complete the steps in this section to connect an air flow sensor to the controller.

**NOTE:** Only the BAC-9021 controller does not have PRESSURE SENSOR ports. For that model, skip this section.

**NOTE:** Use 1/4 inch (6.35 mm) FR tubing. Tubing should not be longer than 20 feet (6 meters).

1. Remove the **black shipping plugs 16** from the PRESSURE SENSOR ports.
2. Connect the high pressure tube from the pressure flow sensor to the **HIGH 18** port on the controller.
3. Connect the low pressure tube from the pressure flow sensor to the **LOW 19** port on the controller.

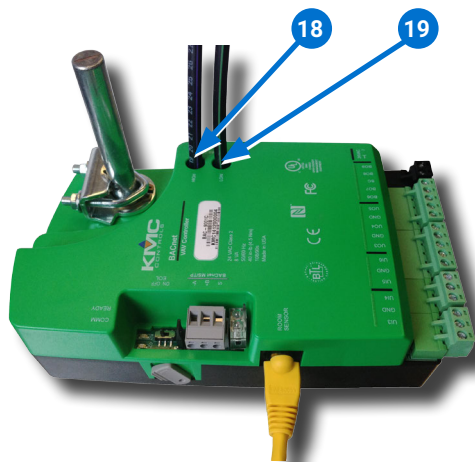


### CONNECT (OPT.) ETHERNET NETWORK

1. For a BAC-9001CE (only), connect an **Ethernet patch cable 20** to the **10/100 ETHERNET** port.


#### ⚠ CAUTION

**On Conquest "E" models, do NOT plug a cable meant for Ethernet communications into the Room Sensor port! The Room Sensor port powers a NetSensor, and the supplied voltage may damage an Ethernet switch or router.**

**NOTE:** Before May 2016, BAC-9001CE models had a **single** Ethernet port **20**. They now have **dual** Ethernet ports **21**, enabling daisy-chaining of controllers. See the **Daisy-Chaining Conquest Ethernet Controllers Technical Bulletin** on the [KMC Partner web site](#) for more information.

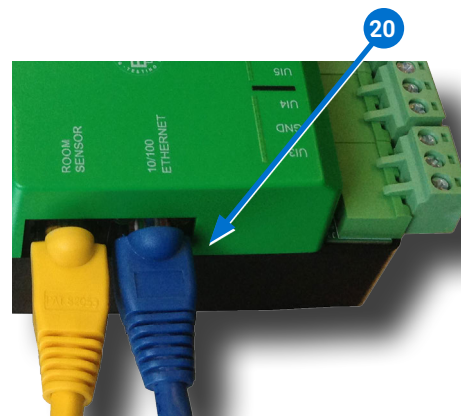

**NOTE:** Also on the newer models, the Room Sensor port is **yellow 22** instead of black to help differentiate it from the black Ethernet ports.

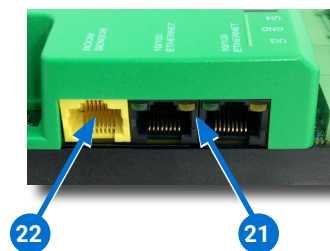


**NOTE:** The Ethernet patch cable should be T568B Category 5 (or better) and a maximum of 328 feet (100 meters) between devices.

## CONNECT (OPTIONAL) MS/TP NETWORK

1. For a BAC-9001 or BAC-9021, connect the network to the gray **BACnet MS/TP network terminal block** 23.

**NOTE:** Use 18 gauge AWG shielded twisted pair cable with maximum capacitance of 51 picofarads per foot (0.3 meters) for all network wiring (Belden cable #82760 or equivalent).

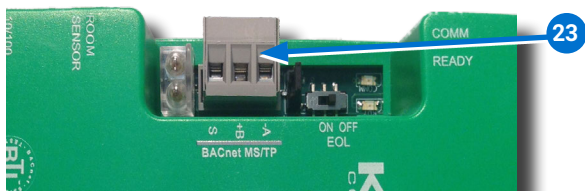


- A. Connect the **-A** terminals in parallel with all other **-A** terminals on the network.
  - B. Connect the **+B** terminals in parallel with all other **+B** terminals on the network.
  - C. Connect the **shields** of the cable together at each device using a wire nut or the **S** terminal in KMC BACnet controllers.
2. Connect the cable shield to a good earth ground at **one end only**.

**NOTE:** For principles and good practices when connecting an MS/TP network, see [Planning BACnet Networks \(Application Note AN0404A\)](#).

**NOTE:** The EOL switch is shipped from the factory in the OFF position.

3. If the controller is at either end of a BACnet MS/TP network (only one wire under each terminal), turn the **EOL switch** 24 to **ON**.


**NOTE:** For more information, see [Sample \(BAC-9001\) Wiring on page 8](#) and the YouTube video [KMC Conquest Wiring: BAC-9000 Series Unitary Controllers](#).

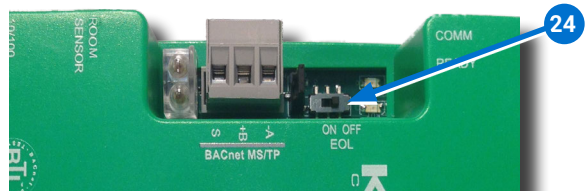

## CONNECT POWER

**NOTE:** Follow all local regulations and wiring codes.

1. Connect a 24 VAC, Class-2 transformer to the **black power terminal block** 25 of the controller.
  - A. Connect the neutral side of the transformer to the controller's **common terminal** 26.
  - B. Connect the AC phase side of the transformer to the controller's **phase terminal** 27.

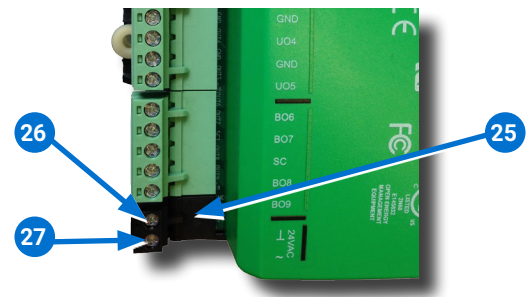

**NOTE:** Connect only one controller to each transformer with 12–24 AWG copper wire.

**NOTE:** Use either shielded connecting cables or enclose all cables in conduit to maintain RF emissions specifications.

**NOTE:** For more information, see [Sample \(BAC-9001\) Wiring on page 8](#) and the YouTube video [KMC Conquest Wiring: BAC-9000 Series Unitary Controllers](#).

## POWER AND COMMUNICATION STATUS

The **status LEDs** indicate power connection and network communication. The descriptions below describe their activity during **normal operation** (at least 5 to 20 seconds **after** power-up/initialization or restart).

**NOTE:** If both the green READY LED and the amber COMM LED remain OFF, check the power and cable connections to the controller.

### Green READY LED 28

After controller power-up or restart is complete, the READY LED flashes steadily about once per second, indicating normal operation.

### Amber (BACnet MS/TP) COMM LED 29

- ◆ During normal operation, the COMM LED flickers as the controller receives and passes the token over the BACnet MS/TP network.
- ◆ When the network is **not** connected or communicating properly, the COMM LED flashes more slowly (about once a second).



### Green ETHERNET LED 30

**NOTE:** The Ethernet status LEDs indicate network connection and communication speed.

- ◆ The green Ethernet LED stays ON when the controller is communicating with the network.
- ◆ The green Ethernet LED is OFF when the (powered) controller is **not** communicating with the network.




### Amber ETHERNET LED 31

- ◆ The amber Ethernet LED flashes when the controller is communicating with a 100BaseT Ethernet network.
- ◆ The amber Ethernet LED remains OFF when the (powered) controller is communicating with the network at only 10 Mbps (instead of 100 Mbps).

**NOTE:** If both the green and amber Ethernet LEDs remain OFF, check the power and network cable connections.

### MS/TP NETWORK ISOLATION BULBS 32

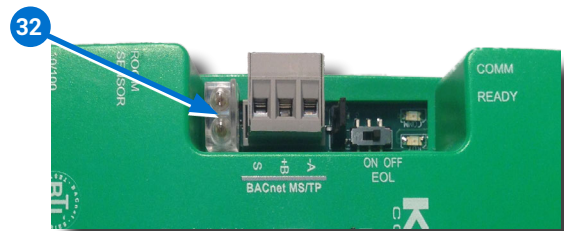


The two **network isolation bulbs 32** serve three functions:

- ◆ Removing the (**HPO-0055**) bulb assembly opens the MS/TP circuit and isolates the controller from the network.
- ◆ If one or both bulbs are ON, the network is improperly phased. This means the ground potential of the controller is not the same as other controllers on the network. If this happens, fix the wiring. See **Connect (Optional) MS/TP Network on page 5**.
- ◆ If the voltage or current on the network exceeds safe levels, the bulbs blow, opening the circuit. If this happens, fix the problem and replace the bulb assembly.

## WATCH DOG JUMPER

The **watch dog jumper 33** resets the controller if there is a power failure or a communication timeout between the controller and the network.

**Never remove the jumper** (from the two outer pins).

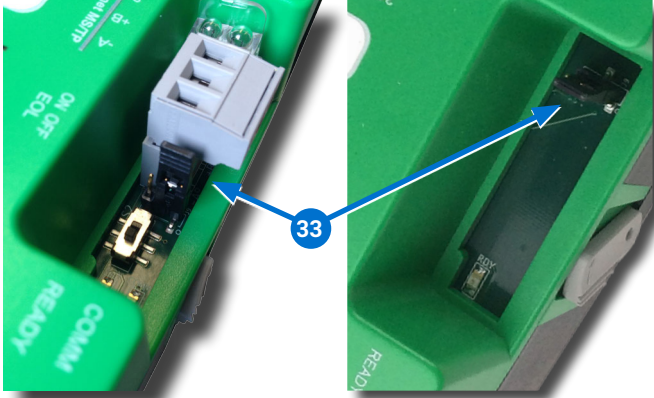

## CONFIGURE/PROGRAM THE CONTROLLER

See the table (on the next page) for the most relevant KMC Controls tools for configuring, programming, and/or creating graphics for the controller. See the tools' documents or Help systems for more information.

**NOTE:** After the controller has been configured, an STE-6010/6014/6017 series analog sensor can be connected to the controller in place of an STE-9000 series digital NetSensor.

**NOTE:** A BAC-9001CE can be configured by connecting an HTML5-compatible web browser to the controller's default IP address (192.168.1.251). See the [Conquest Ethernet Controller Configuration Web Pages Application Guide](#) for more information about the built-in configuration web pages.

SETUP PROCESS			KMC CONTROLS TOOL
Config-uration	Programming (Control Basic)	Web Page Graphics*	
✓			Conquest NetSensor
✓			Internal configuration web pages in Conquest Ethernet "E" models**
✓			KMC Connect Lite™ (NFC) app***
✓	✓		KMC Connect™ software
✓****	✓****	✓	TotalControl™ software
✓	✓		KMC Converge™ module for Niagara WorkBench
		✓	KMC Converge <b>GFX</b> module for Niagara WorkBench

\*Custom graphical user-interface web pages can be hosted on a remote web server, but not in the controller.

\*\*Conquest Ethernet-enabled "E" models with the latest firmware can be configured with an HTML5 compatible web browser from pages served from within the controller. For information, see the [Conquest Ethernet Controller Configuration Web Pages Application Guide](#).

\*\*\*Near Field Communication via enabled smart phone or tablet running the KMC Connect Lite app.

\*\*\*\*Full configuration and programming of KMC Conquest controllers is supported starting with TotalControl ver. 4.0.




# SAMPLE (BAC-9001) WIRING

## (Single Duct VAV, Series Fan Powered with Floating Reheat and Vent Control)

BAC-9001/9001CE Controller

**NOTE:** For MS/TP models, turn the End Of Line switch ON at both physical ends of the MS/TP network. Connect the cable shield to earth ground at only one point.

**NOTE:** For more wiring examples, see the wiring diagrams that are part of the application library in KMC Connect, Converge, or TotalControl.

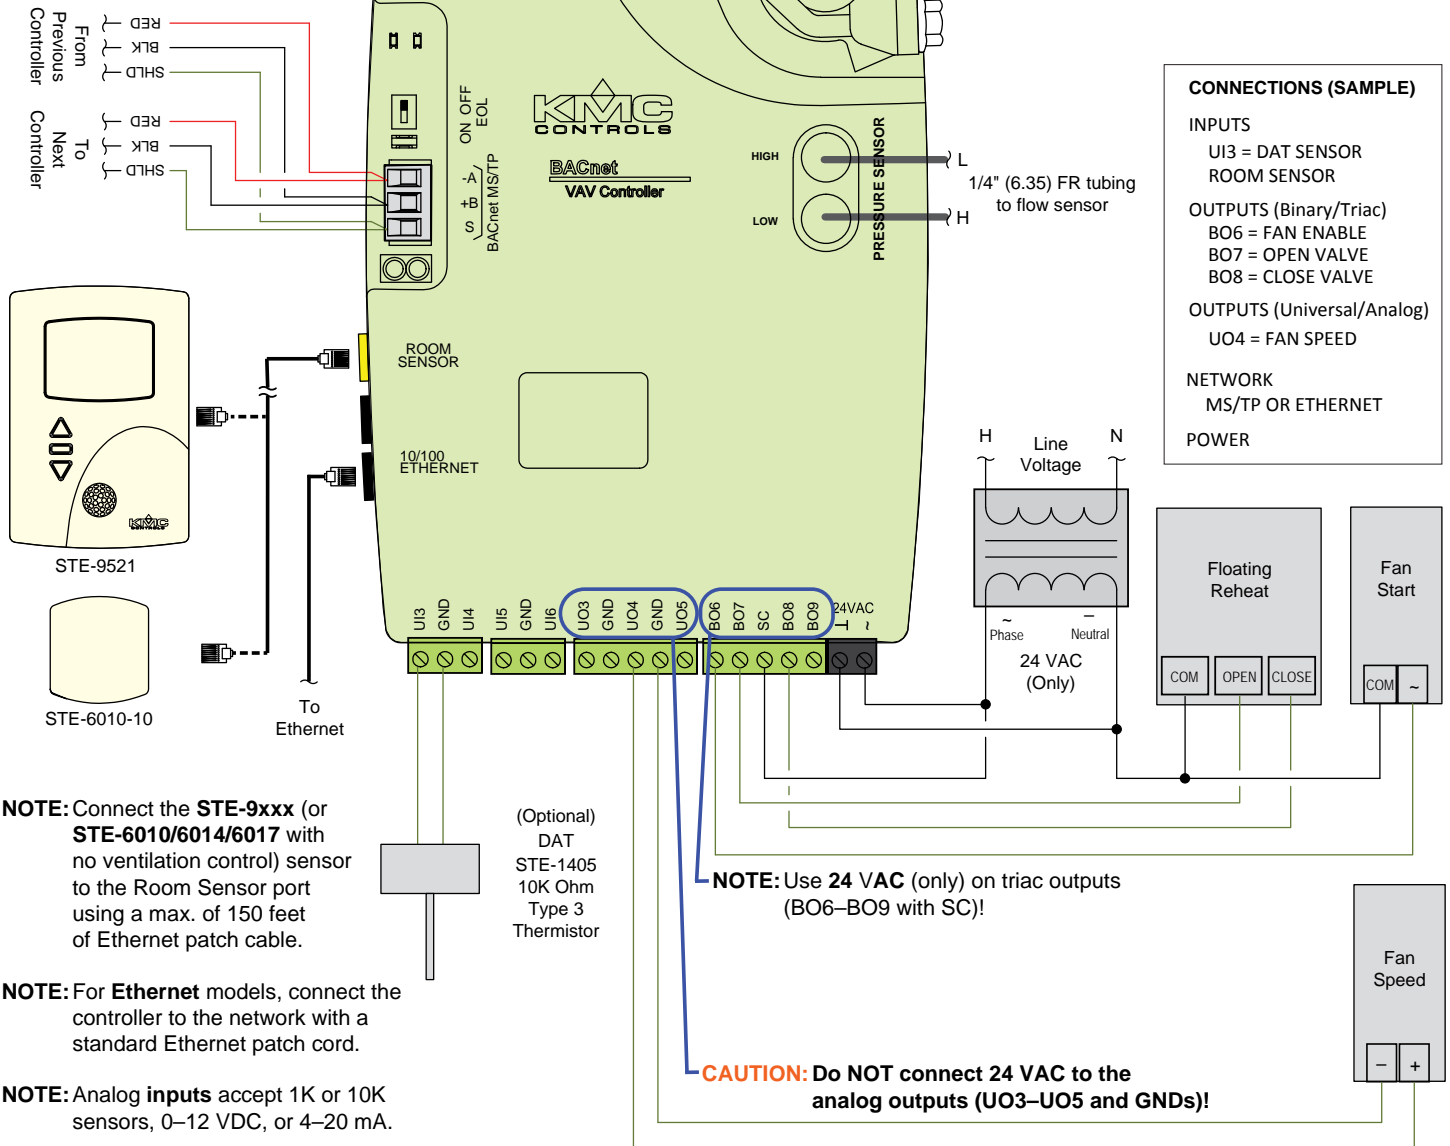

**NOTE:** Connect the STE-9xxx (or STE-6010/6014/6017 with no ventilation control) sensor to the Room Sensor port using a max. of 150 feet of Ethernet patch cable.

**NOTE:** For Ethernet models, connect the controller to the network with a standard Ethernet patch cord.

**NOTE:** Analog inputs accept 1K or 10K sensors, 0–12 VDC, or 4–20 mA.



## INPUT/OUTPUT OBJECTS/CONNECTIONS

BAC-9001 SINGLE DUCT	
Inputs (Objects/Terminals)	
A11	Space Sensor <i>(on Room Sensor port)</i>
A12	Space Setpoint Offset <i>(on port)</i>
A13/UI3	Discharge Air Temperature
A14/UI4	Analog Input #4
A15/UI5	Analog Input #5
A16/UI6	Analog Input #6
A17	Primary Duct Pressure <i>(internal sensor)</i>
A18	Primary Damper Position <i>(internal sensor)</i>
Outputs (Objects/Terminals)	
A03/U03	Analog Heat*
A04/U04	Fan Speed
A05/U05	Analog Output #5
B01	Primary Damper CW <i>(internal actuator)</i>
B02	Primary Damper CCW <i>(internal actuator)</i>
B06	Fan
B07	Heating Stage 1*
B08	Heating Stage 2*
B09	Heating Stage 3*
<b>*NOTE ABOUT REHEAT:</b>	
<ul style="list-style-type: none"> <li>When <b>staged</b> heating is configured (on MSV3), B07, B08, and B09 activate in sequence.</li> <li>When <b>floating</b> (tri-state) heating is configured, B07 opens and B08 closes (B09 is not used).</li> <li>When <b>time proportional</b> heating is configured, B07 is the controlling output (B08 and B09 are not used).</li> <li>A03 is always active (and a voltage test on it always reflects the heating PID loop value even when A03 is not the controlling output). When <b>modulating</b> heating is configured, A03 is the controlling output (B07, B08, and B09 are not used).</li> </ul>	

BAC-9021 PRESSURE DEPENDENT	
Inputs	
A11	Space Sensor <i>(on Room Sensor port)</i>
A12	Space Setpoint Offset <i>(on port)</i>
A13/UI3	Discharge Air Temperature
A14/UI4	Analog Input #4
A15/UI5	Analog Input #5
A16/UI6	Analog Input #6
	<i>(No internal pressure sensor in this model)</i>
A18	Primary Damper Position <i>(internal sensor)</i>
Outputs	
A03/U03	Analog Heat*
A04/U04	Analog Output #4
A05/U05	Analog Output #5
B01	Primary Damper CW <i>(internal actuator)</i>
B02	Primary Damper CCW <i>(internal actuator)</i>
B06	Binary Output #6
B07	Heating Stage 1*
B08	Heating Stage 2*
B09	Heating Stage 3*
<b>*See NOTE ABOUT REHEAT above.</b>	

BAC-9001 DUAL DUCT	
Inputs	
A11	Space Sensor <i>(on Room Sensor port)</i>
A12	Space Setpoint Offset <i>(on port)</i>
A13/UI3	Discharge Air Temperature
A14/UI4	Analog Input #4
A15/UI5	Secondary Duct Pressure
A16/UI6	Secondary Damper Position
A17	Primary Duct Pressure <i>(internal sensor)</i>
A18	Primary Damper Position <i>(internal sensor)</i>
Outputs	
A03/U03	Analog Output #3
A04/U04	Analog Output #4
A05/U05	Analog Output #5
B01	Primary Damper CW <i>(internal actuator)</i>
B02	Primary Damper CCW <i>(internal actuator)</i>
B06	Binary Output #6
B07	Secondary Damper CW
B08	Secondary Damper CCW
B09	Binary Output #9

**NOTE:** For more information, see [Sample \(BAC-9001\) Wiring on page 8](#).

**NOTE:** Universal Input (UIx) terminal = Analog Input (AIx) object. Universal Output (UOx) terminal = Analog Output (AOx) object.

**NOTE:** Universal (analog) inputs and outputs can be configured to emulate binary (on/off or voltage/no-voltage) objects. They are used with GND terminals.

**NOTE:** Binary Output (BOx) terminals are triacs and are used with SC terminals instead of GND terminals.

## REPLACEMENT PARTS

**HPO-0055** Replacement Network  
Bulb Module for Conquest  
Controllers, Pack of 5

**HPO-9901** Conquest Hardware  
Replacement Parts Kit

**NOTE:** HPO-9901 includes the following:

<b>Terminal Blocks</b>	<b>DIN Clips</b>
(1) Black 2 Position	(2) Small
(2) Grey 3 Position	(1) Large
(2) Green 3 Position	
(4) Green 4 Position	
(2) Green 5 Position	
(2) Green 6 Position	

**NOTE:** See the **Conquest Selection Guide** for more information about replacement parts and accessories.

## IMPORTANT NOTICES

The material in this document is for information purposes only. The contents and the product it describes are subject to change without notice.

KMC Controls, Inc. makes no representations or warranties with respect to this document. In no event shall KMC Controls, Inc. be liable for any damages, direct, or incidental, arising out of or related to the use of this document.

The KMC logo is a registered trademark of KMC Controls, Inc. All rights reserved.

TEL: 574.831.5250

FAX: 574.831.5252

EMAIL: [info@kmccontrols.com](mailto:info@kmccontrols.com)

