



# Anemostat®

SECURITY AIR DISTRIBUTION


Model **SV23-ZB**

## SUBMITTAL SHEET

www.anemostat-hvac.com

LIGATURE RESISTANT GRILLE  
7/16" X 3/16" APERTURES

MAXIMUM SECURITY • FACE MOUNTED Z-BRACKET

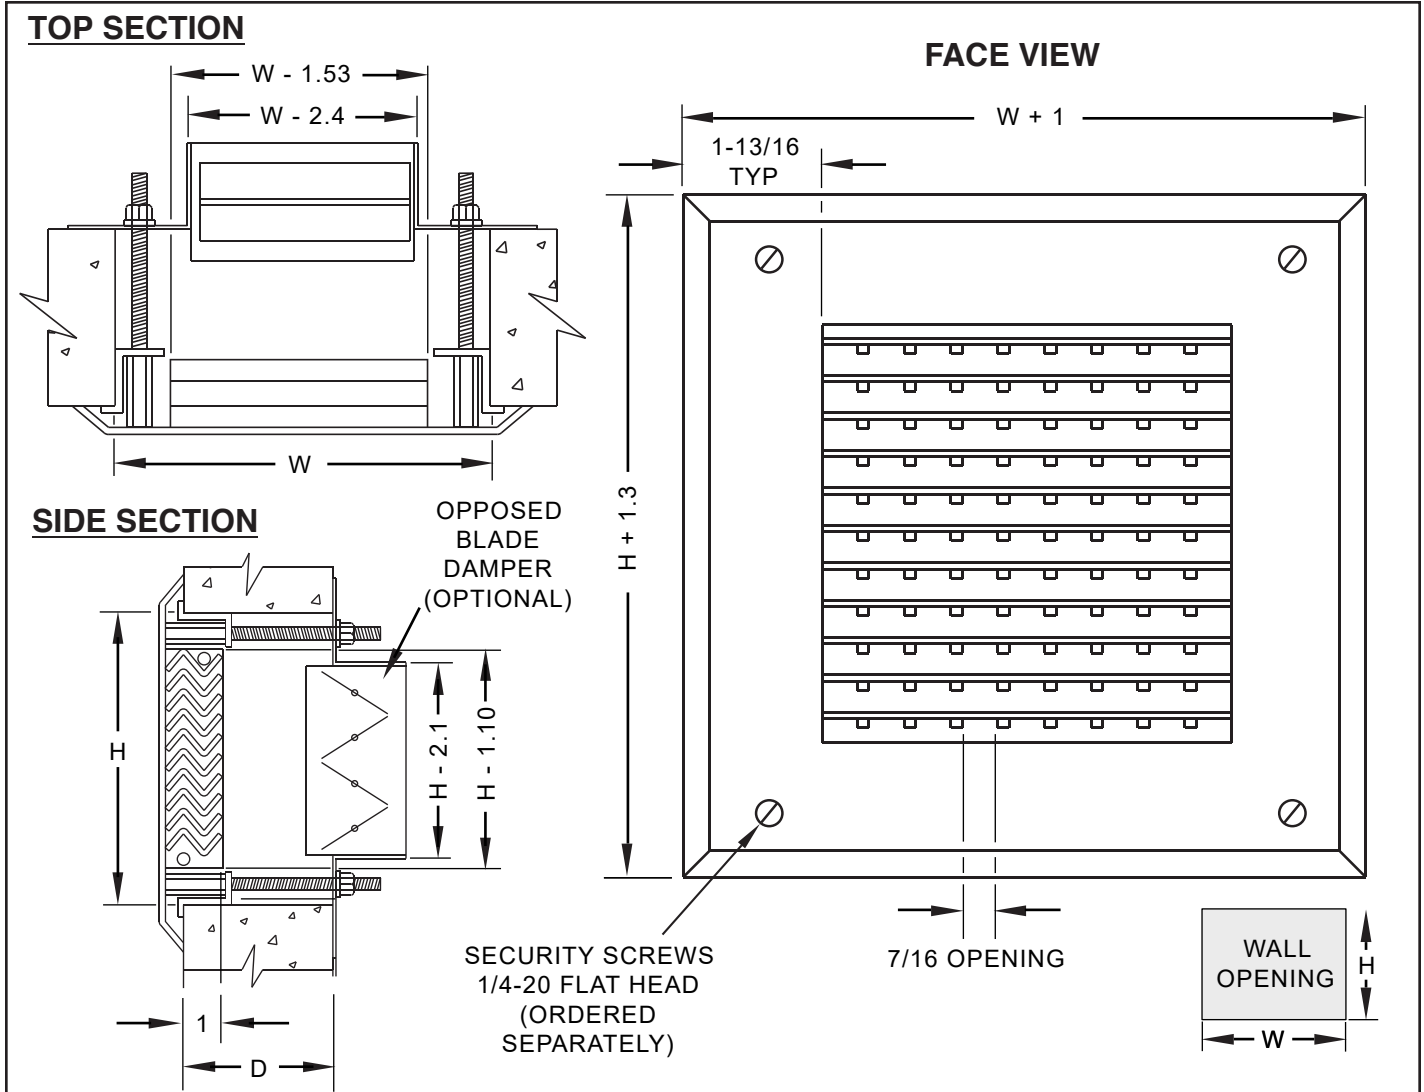

**IMPORTANT:** It is the specifier's responsibility to properly configure the HVAC system to meet the appropriate level of comfort, safety, security and detention

### PRODUCT FEATURES

#### Grille Construction

- 304 Stainless Steel
- 14 Gauge Face and Core
- Coupling Nuts with Threaded Rod
- Z-Bracket, Galvanized Steel
- Duct Collar, 14 Gauge Galvanized Steel

#### Finish

- #4 Satin Polish (STANDARD)
- Arctic White Powder Coat
- Other \_\_\_\_\_

#### Options

- Model OB-1 Opposed Blade Damper (**Rear Operated**, Galvzd Steel, Field Installed)
- Model OB-1 Opposed Blade Damper (**Front Operated**, Galvzd Steel, Field Installed) - S-VENT Grille removable for damper adjustment

QTY	Order Size	D Wall Depth

All dimensions are in inches.

JOB NAME:

SUBMITTED BY:



# SUBMITTAL SHEET

**LIGATURE RESISTANT GRILLE**  
**7/16" X 3/16" APERTURES**

www.anemostat-hvac.com


**MAXIMUM SECURITY • FACE MOUNTED Z-BRACKET**

## ORDER SIZE

Order size is based on the table below and determines the rough opening size in the wall. For example, an S-Vent grille Order Size C3 requires a wall rough opening of 10.4" wide x 10.1" high.

		W = WIDTH (ROUGH OPENING)								
		6.4	8.4	10.4	12.4	14.4	16.4	18.4	20.4	22.4
H = HEIGHT (ROUGH OPENING)	6.1	A1	B1	C1	D1	E1	F1	G1	H1	J1
	8.1	A2	B2	C2	D2	E2	F2	G2	H2	J2
	10.1	A3	B3	C3	D3	E3	F3	G3	H3	J3
	12.1	A4	B4	C4	D4	E4	F4	G4	H4	J4
	14.1	A5	B5	C5	D5	E5	F5	G5	H5	J5
	16.1	A6	B6	C6	D6	E6	F6	G6	H6	J6
	18.1	A7	B7	C7	D7	E7	F7	G7	H7	J7
	20.1	A8	B8	C8	D8	E8	F8	G8	H8	J8
	22.1	A9	B9	C9	D9	E9	F9	G9	H9	J9

## INSTALLATION (EXPLODED VIEW)

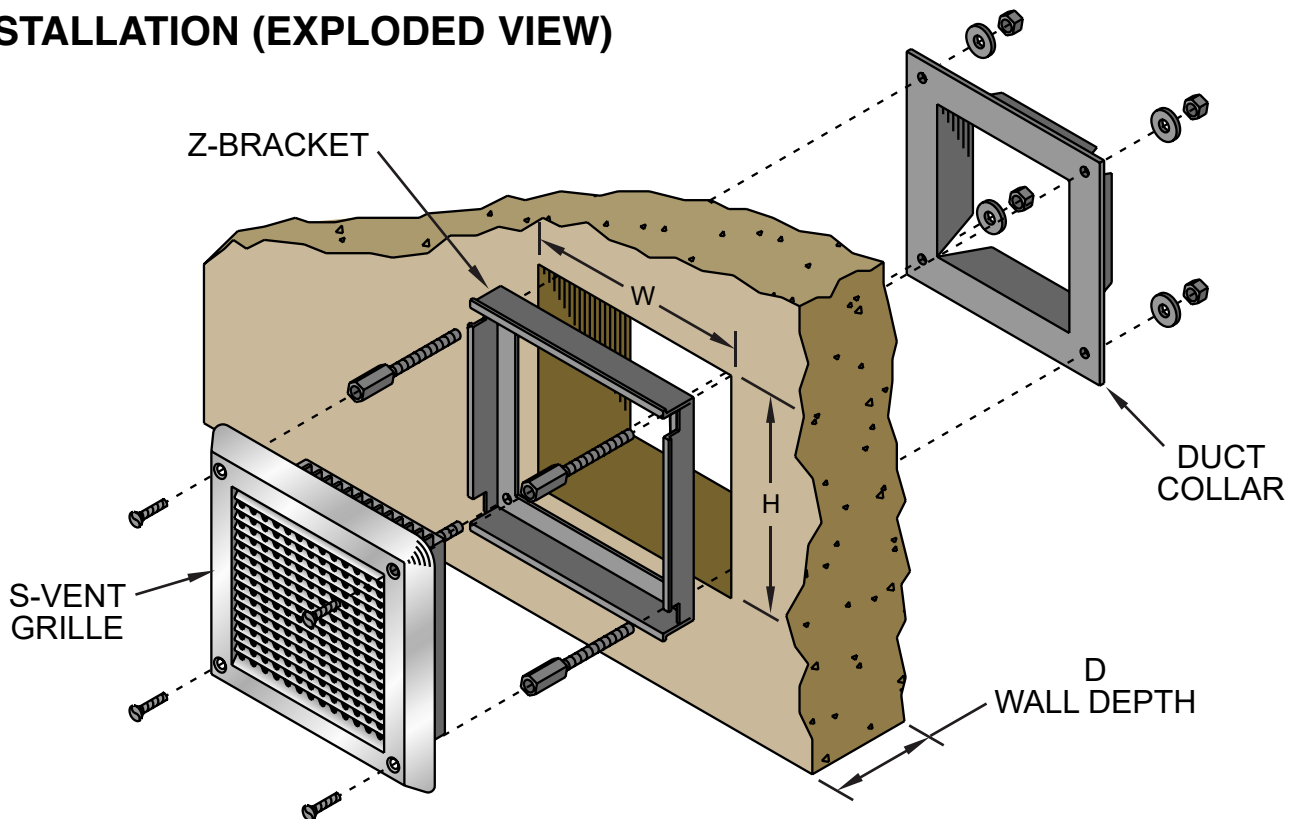

JOB NAME:

SUBMITTED BY: