



**Anemostat®**  
SECURITY AIR DISTRIBUTION

**S-VENT  
RETROFIT**


Model **SV42-IP**

# SUBMITTAL SHEET

www.anemostat-hvac.com

**LIGATURE RESISTANT GRILLE**  
**3/16" X 3/16" APERTURES**

**MAXIMUM SECURITY • RETROFIT APPLICATION**

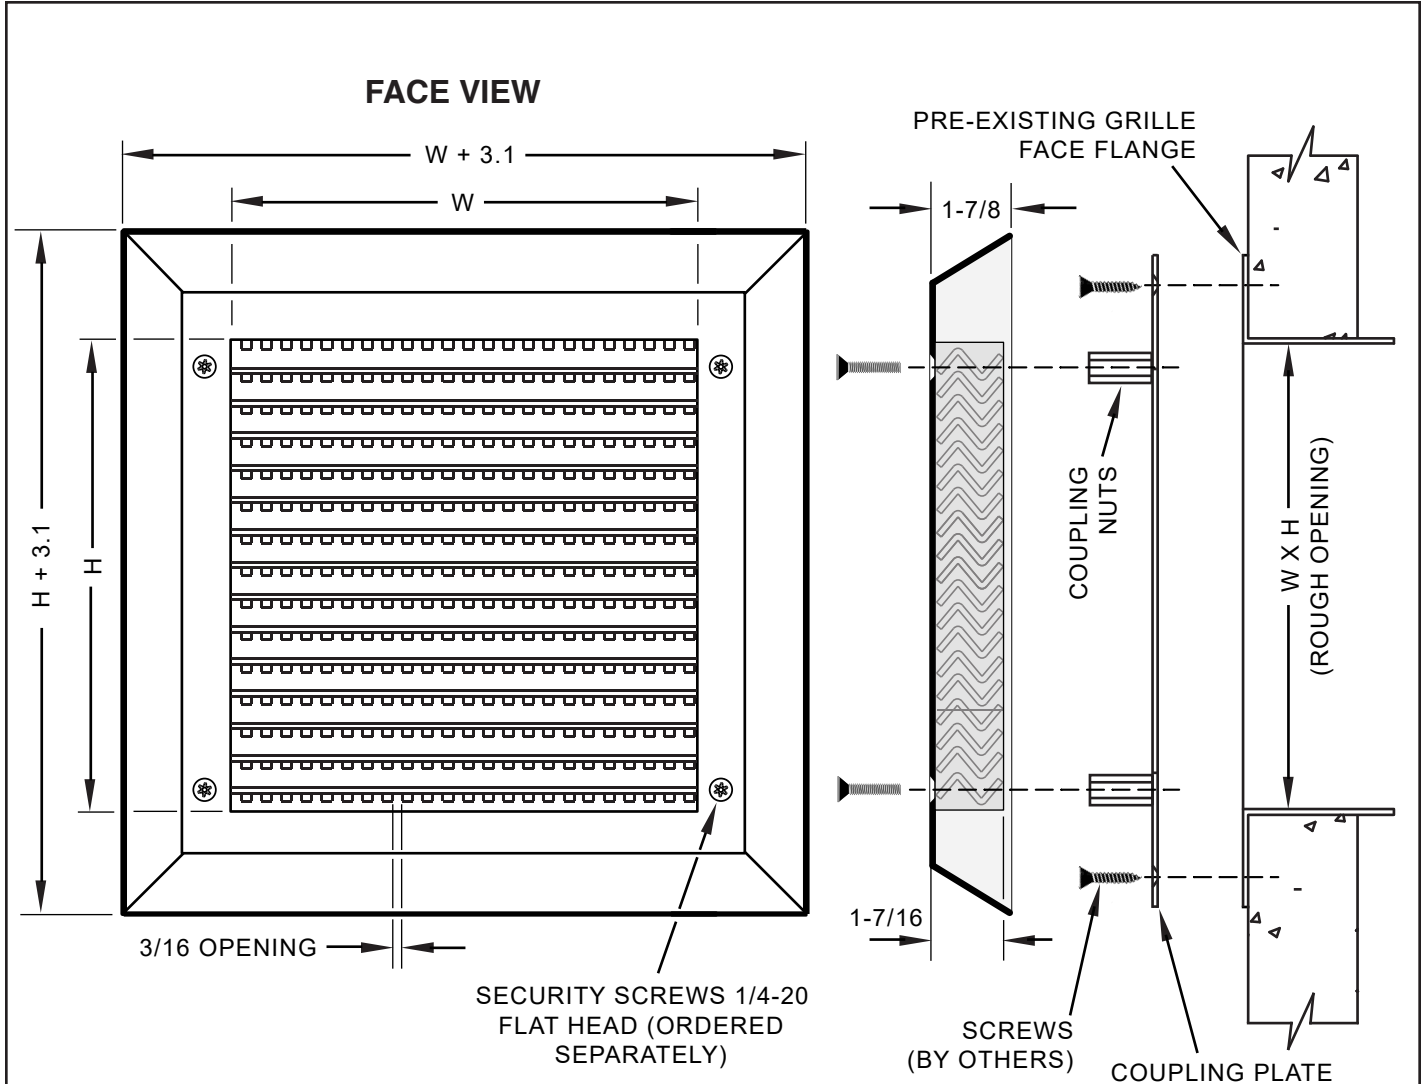

**IMPORTANT:** It is the specifier's responsibility to properly configure the HVAC system to meet the appropriate level of comfort, safety, security and detention

## PRODUCT FEATURES

### Grille Construction

- 304 Stainless Steel
- 14 Gauge Face and Core
- Coupling Plate, 14 Gauge Galvanized Steel (attaching screws provided by others)
- 1/4-20 x 1-1/4" security machine screws (ordered separately)

### Finish

- ☐ #4 Satin Polish (STANDARD)
- ☐ Arctic White Powder Coat
- ☐ Other \_\_\_\_\_

All dimensions are in inches.

**QTY** **Order Size**

**APPROVED BY THE NY STATE OFFICE OF MENTAL HEALTH**

**JOB NAME:**

**SUBMITTED BY:**



# Anemostat®

SECURITY AIR DISTRIBUTION



Model **SV42-IP**

## SUBMITTAL SHEET

www.anemostat-hvac.com


**LIGATURE RESISTANT GRILLE**  
**3/16" X 3/16" APERTURES**

**MAXIMUM SECURITY • RETROFIT APPLICATION**

### ORDER SIZE

Order size is based on the table below and determines the rough opening size in the pre-existing grille. For example, an S-Vent grille Order Size C3 requires a grille rough opening of 9.4" wide x 9.4" high. Note the overall pre-existing grille flange and verify the S-Vent grille covers the entire flange.

		W = WIDTH (ROUGH OPENING)								
		5.4	7.4	9.4	11.4	13.4	15.4	17.4	19.4	21.4
H = HEIGHT (ROUGH OPENING)	5.4	A1	B1	C1	D1	E1	F1	G1	H1	J1
	7.4	A2	B2	C2	D2	E2	F2	G2	H2	J2
	9.4	A3	B3	C3	D3	E3	F3	G3	H3	J3
	11.4	A4	B4	C4	D4	E4	F4	G4	H4	J4
	13.4	A5	B5	C5	D5	E5	F5	G5	H5	J5
	15.4	A6	B6	C6	D6	E6	F6	G6	H6	J6
	17.4	A7	B7	C7	D7	E7	F7	G7	H7	J7
	19.4	A8	B8	C8	D8	E8	F8	G8	H8	J8
	21.4	A9	B9	C9	D9	E9	F9	G9	H9	J9

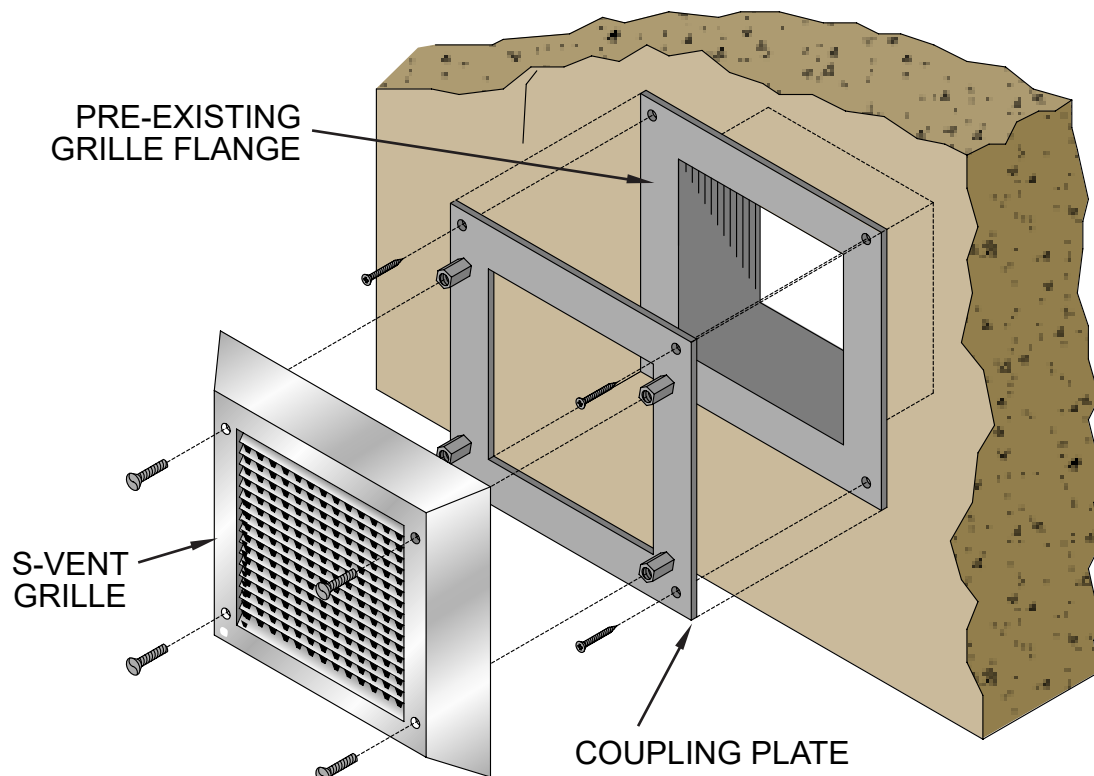

JOB NAME:

SUBMITTED BY: