



Anemostat®
SECURITY AIR DISTRIBUTION

**S-VENT
RETROFIT**


Model **SV6-IP**

SUBMITTAL SHEET

www.anemostat-hvac.com

LIGATURE RESISTANT GRILLE
2" X 3/16" APERTURES

MAXIMUM SECURITY • RETROFIT APPLICATION

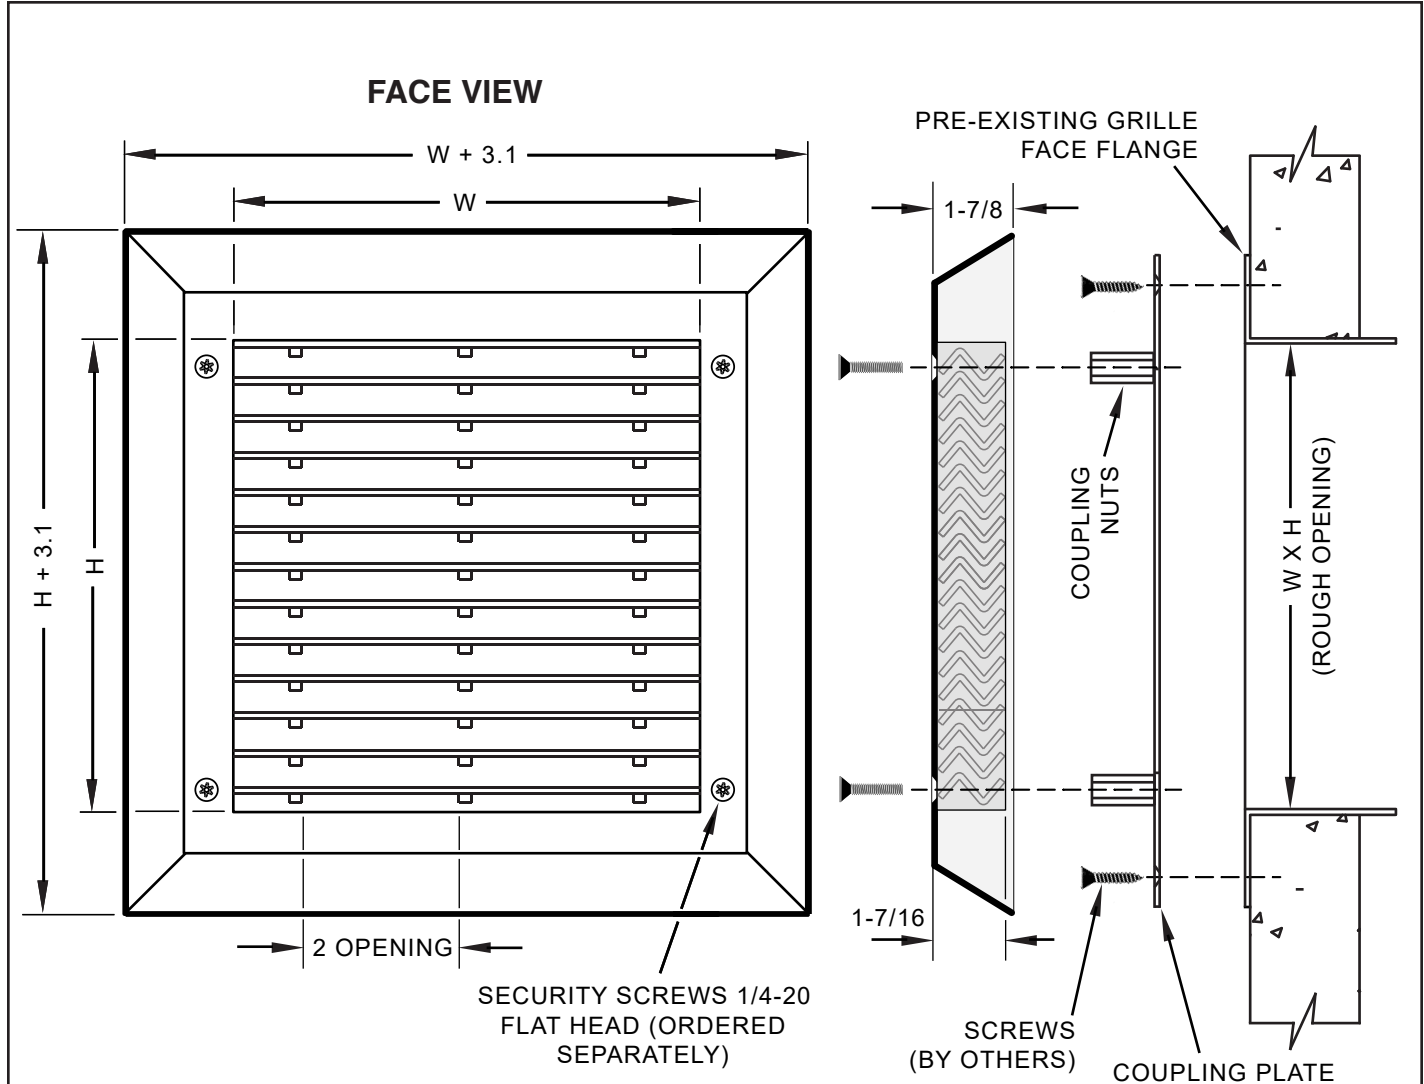

IMPORTANT: It is the specifier's responsibility to properly configure the HVAC system to meet the appropriate level of comfort, safety, security and detention

PRODUCT FEATURES

Grille Construction

- Cold Rolled Steel (CRS)
- 14 Gauge Face and Core
- Coupling Plate, 14 Gauge Galvanized Steel (attaching screws provided by others)
- 1/4-20 x 1-1/4" security machine screws (ordered separately)

Finish

- ☐ **White Powder Coat (STANDARD)**
- ☐ Other _____

All dimensions are in inches.

QTY

Order Size

APPROVED BY THE NY STATE OFFICE OF MENTAL HEALTH

JOB NAME:

SUBMITTED BY:



Anemostat®

SECURITY AIR DISTRIBUTION

**S-VENT
RETROFIT**

Model **SV6-IP**

SUBMITTAL SHEET

www.anemostat-hvac.com


LIGATURE RESISTANT GRILLE
2" X 3/16" APERTURES

MAXIMUM SECURITY • RETROFIT APPLICATION

ORDER SIZE

Order size is based on the table below and determines the rough opening size in the pre-existing grille. For example, an S-Vent grille Order Size C3 requires a grille rough opening of 9.4" wide x 9.4" high. Note the overall pre-existing grille flange and verify the S-Vent grille covers the entire flange.

		W = WIDTH (ROUGH OPENING)								
		5.4	7.4	9.4	11.4	13.4	15.4	17.4	19.4	21.4
H = HEIGHT (ROUGH OPENING)	5.4	A1	B1	C1	D1	E1	F1	G1	H1	J1
	7.4	A2	B2	C2	D2	E2	F2	G2	H2	J2
	9.4	A3	B3	C3	D3	E3	F3	G3	H3	J3
	11.4	A4	B4	C4	D4	E4	F4	G4	H4	J4
	13.4	A5	B5	C5	D5	E5	F5	G5	H5	J5
	15.4	A6	B6	C6	D6	E6	F6	G6	H6	J6
	17.4	A7	B7	C7	D7	E7	F7	G7	H7	J7
	19.4	A8	B8	C8	D8	E8	F8	G8	H8	J8
	21.4	A9	B9	C9	D9	E9	F9	G9	H9	J9

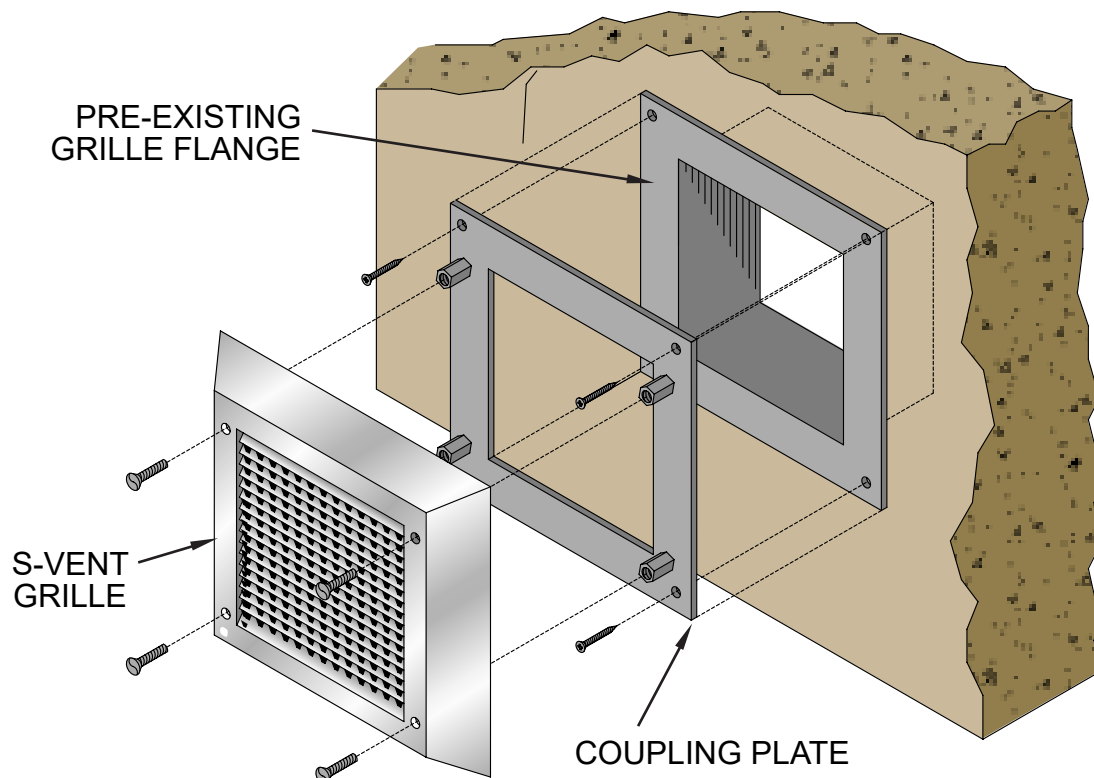

JOB NAME:

SUBMITTED BY: